



Interlock, mechanical, for remote operator

Part no.

Catalog No.

NZM3/4-XMVR

104546

Similar to illustration

Delivery program

Description			For 2 switches of the same or next frame size with each other Mounting beside one another
For use with			NZM3(-4), N(S)3(-4) + NZM4(-4), N(S)4(-4)
Notes			
Type contains parts for both switch sides.			
Extension shaft additionally required.			
Max. switch clearances Engineering			
Can not be combined with rotary handles, door coupling rotary handles, early-make auxiliary contacts, and direct-switching remote operator NZM2-XRD.			


Design verification as per IEC/EN 61439

IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Mechanic interlock for switch (EC001044)			
Electric engineering, automation, process control engineering / Low-voltage switch technology / Component for low-voltage switching technology / Mechanic interlock for switch (ecI@ss10.0.1-27-37-13-03 [AKN341013])			
Auxiliary contacts, extendable			No
Number of contacts as normally closed contact			0
Number of contacts as normally open contact			0

Dimensions

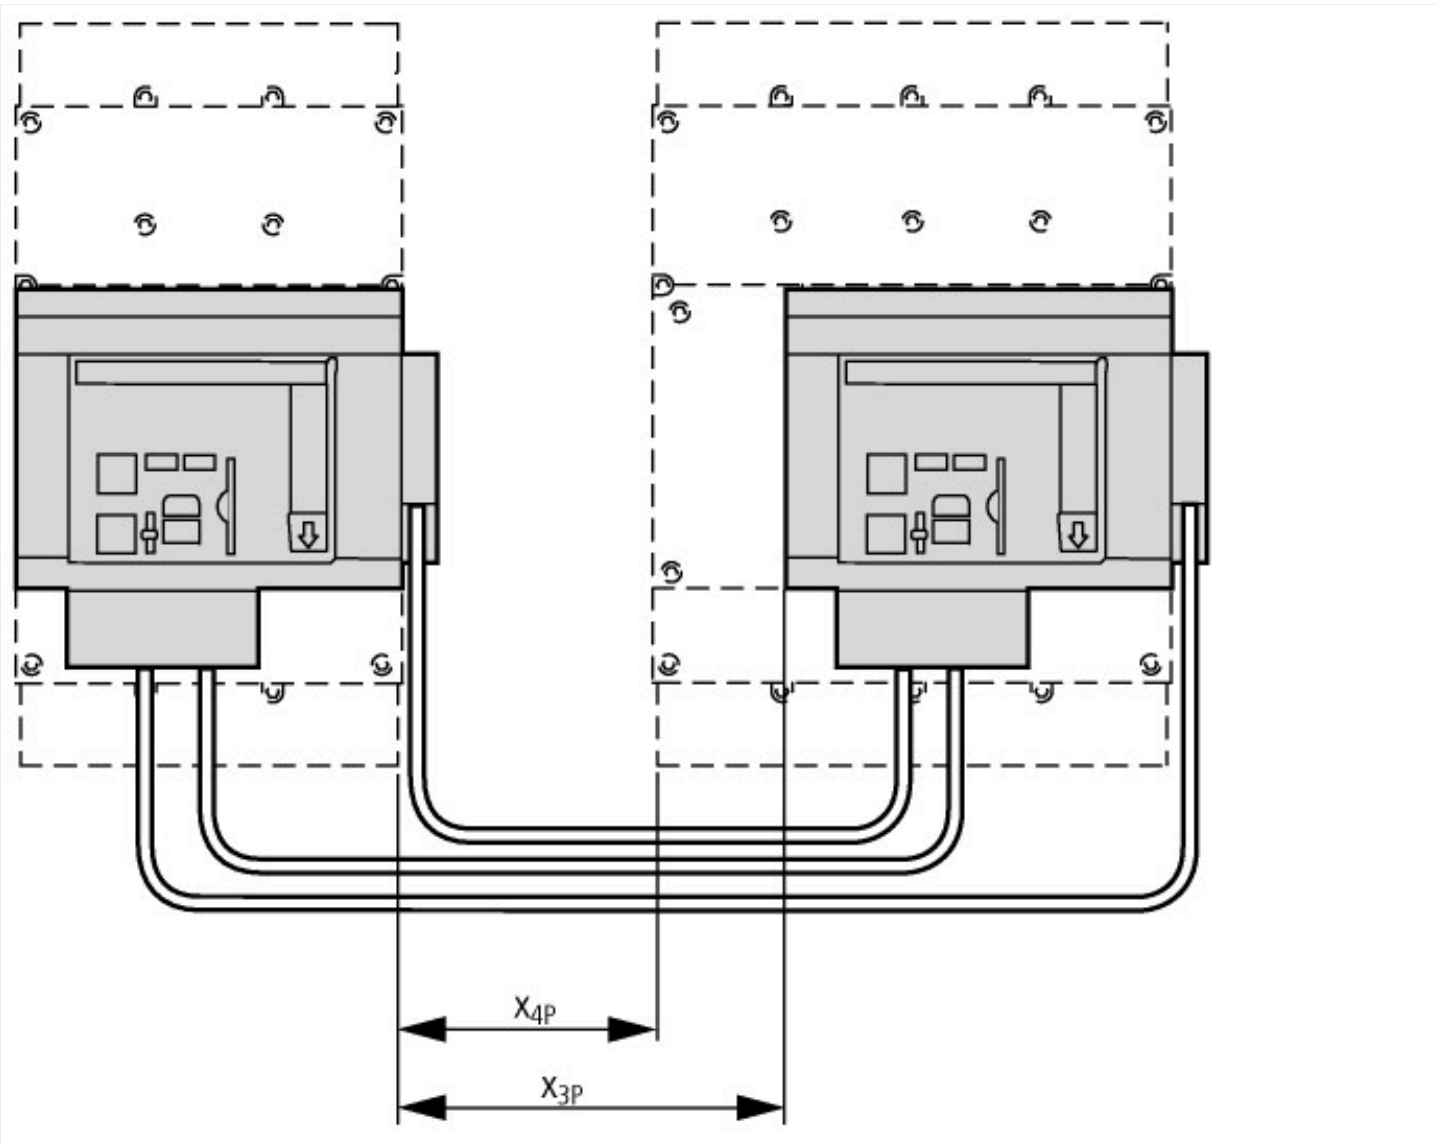

Additional product information (links)

IL01219034Z (AWA1230-2335) mechanical interlock for NZM4 remote operator	
IL01219034Z (AWA1230-2335) mechanical interlock for NZM4 remote operator	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01219034Z2012_09.pdf
IL01219035Z (AWA1230-2350) mechanical interlock for NZM2 remote operator	
IL01219035Z (AWA1230-2350) mechanical interlock for NZM2 remote operator	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01219035Z2012_09.pdf