DATASHEET - LN2-160-I

Switch-disconnector, 3 p, 160A, frame size 2



Part no. Catalog No. LN2-160-I 112002



Similar to illustration

Delivery program

Product range			Switch-disconnectors
Protective function			Disconnectors/main switches
Standard/Approval			IEC
Installation type			Fixed
Construction size			LN2
Description			Main switch characteristics including positive drive to IEC/EN 60204 and VDE 0113. Isolating characteristics to IEC/EN 60947-3 and VDE 0660. Busbar tag shroud to VDE 0160 Part 100.
Number of poles			3 pole
Standard equipment			Screw connection
Switch positions			I, +, 0
Rated current = rated uninterrupted current	$I_n = I_u$	А	160
Short-circuit protection max. fuse gL-characteristic		A gL	250

Technical data

Switch-disconnectors

Rated surge voltage invariability	U _{imp}		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	Ue	V AC	690
Rated operating frequency	f	Hz	50/60
Rated current = rated uninterrupted current	$I_n = I_u$	А	160
Overvoltage category/pollution degree			111/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems		V	≦ 690
Rated short-circuit making capacity			
690 V 50/60 H	lc	kA	5.5
Rated short-time withstand current			
t = 0.3 s	I _{cw}	kA	3.5
t = 1 s	I _{cw}	kA	3.5
Rated conditional short-circuit current			
With back-up fuse		A gG/gL	PN2(N2)-160250: 250
400 415 V		kA	100
690 V		kA	80
With downstream fuse		A gG/gL	PN2(N2)-160250: 250
400 415 V		kA	100
690 V		kA	80
Rated making and breaking capacity			
Rated operational current	l _e	А	
415 V	l _e	А	250
690 V	le	А	250
415 V	l _e	А	250
690 V	le	А	250
Lifespan, mechanical	Operations		20000
Max. operating frequency		Ops/h	120

Lifespan, electrical			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000
690 V 50/60 Hz	Operations		7500
400 V 50/60 Hz	Operations		7500
415 V 50/60 Hz	Operations		7500
690 V 50/60 Hz	Operations		5000
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Screw connection
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (4 - 16) 2 x (4 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal			
Solid		mm ²	1 x (16 - 185)
Stranded			
Stranded		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (4 - 16) 2 x (4 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Al conductors, Cu cable			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 × 16 × 0.8
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 × 16 × 0.8
Flat copper strip, with holes	max.	mm	10 x 16 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min.	mm	16 x 5
	max.	mm	20 × 5
Control cables			
		mm ²	1 × (0.75 - 2.5)
			2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	А	160
Equipment heat dissipation, current-dependent	P _{vid}	W	19.6608
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			

10.2.2 Corrosion resistance Meets the product standard's requirements. 10.2.3 Verification of themal stability of enclosures Meets the product standard's requirements. 10.2.3 Verification of resistance of insulating materials to abnormal heat Meets the product standard's requirements. 10.2.3 Verification of resistance of insulating materials to abnormal heat Meets the product standard's requirements. 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 10.2.5 Lifting Meets the product standard's requirements. 10.2.5 Lifting Dees not apply, since the entire switchgar needs to be evaluated. 10.2.5 Lifting Dees not apply, since the entire switchgar needs to be evaluated. 10.2.5 Lifting Dees not apply, since the entire switchgar needs to be evaluated. 10.2.5 Lifting Dees not apply, since the entire switchgar needs to be evaluated. 10.2.5 Lifting Dees not apply, since the entire switchgar needs to be evaluated. 10.2.5 Lifting Dees not apply, since the entire switchgar needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.6 Incorporation of switching devices and components Meets the product standard's requirements. <th></th> <th></th>		
102.3.2 Verification of resistance of insulating materials to abnormal heat Meets the product standard's requirements. 102.3.3 Verification of resistance of insulating materials to abnormal heat Meets the product standard's requirements. 102.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 102.5 Lifting Does not apply, since the entire switchgear needs to be evaluated. 102.5 Log Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 103.2 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 104.6 Learances and creepage distances Does not apply, since the entire switchgear needs to be evaluated. 105.7 Internal electric shock Does not apply, since the entire switchgear needs to be evaluated. 105.8 Connection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 105.9 Fortection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 105.9 Instanting devices and components Does not apply, since the entire switchgear needs to be evaluated. 105.9 Instanting proverise Does not apply, since the entire switchgear needs to be evaluated. 109.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.1 Short-circuit rating Is the panel builder's re	10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects Meets the product standard's requirements. 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 10.2.5 Lifting Does not apply, since the entire switchgear needs to be evaluated. 10.2.6 Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 10.3.0 Egree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Does not apply, since the entire switchgear needs to be evaluated. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility. 10.9.1 Short-circuit rating Is the panel builder's responsibility. 10.1 Short-circuit rating Is the panel builder's responsibility. The specifications f	10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
and fire due to internal electric effects Meta the product standard's requirements. 10.2.4 Resistance to ultra-violet (UV) radiation Dees not apply, since the entire switchgear needs to be evaluated. 10.2.5 Lifting Dees not apply, since the entire switchgear needs to be evaluated. 10.2.6 Mechanical impact Dees not apply, since the entire switchgear needs to be evaluated. 10.2.7 Inscriptions Meets the product standard's requirements. 10.3.0 Egree of protection of ASSEMBLIES Dees not apply, since the entire switchgear needs to be evaluated. 10.4.1 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Dees not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Dees not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Dees not apply, since the entire switchgear needs to be evaluated. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.8 Janpulse withstand voltage Is the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Inpulse withstand voltage Is the panel builder's responsibility. <td< td=""><td>10.2.3.2 Verification of resistance of insulating materials to normal heat</td><td>Meets the product standard's requirements.</td></td<>	10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.25 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.26 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.27 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsDoes not apply, since the entire switchgear needs to be evaluated.10.9 Insulation propertiesIs the panel builder's responsibility.10.9.1 Second to starge distanceIs the panel builder's responsibility.10.9.2 Power-frequency electric strengthIs the panel builder's responsibility.10.9.3 Inpulse withstand voltageIs the panel builder's responsibility.10.10 Temperature riseIs the panel builder's responsibility.10.11 Short-circuit ratingIs the panel builder's responsibility.10.12 Electromagnetic compatibility.Is the panel builder's responsibility.10.13 Mechanical functionIs the panel builder's responsibility.10.13 Mechanical functionIs the panel builder's responsibility.10.13 Mechanical functionIs the panel builder's responsibility.10.14 MeetaIs the panel builder's responsibility.10.15 Mechanical functionIs the panel		Meets the product standard's requirements.
10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsIs the panel builder's responsibility.10.8 Connections for external conductorsIs the panel builder's responsibility.10.9.2 Power-frequency electric strengthIs the panel builder's responsibility.10.3 Impulse withstand voltageIs the panel builder's responsibility.10.10 Temperature riseIs the panel builder's responsibility.10.11 Short-circuit ratingIs the panel builder's responsibility.10.12 Electromagnetic compatibilityIs the panel builder's responsibility.10.13 Mechanical functionIs the panel builder's responsibility.	10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder 's responsibility. 10.10 Temperature rise Is the panel builder's responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided	10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.3 Degree of protection of ASSEMBLIES Dees not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Dees not apply, since the entire switchgear needs to be evaluated. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder's responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility. 10.9.1 Rules withstand voltage Is the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.9.1 Temperature rise Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder's responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.2.7 Inscriptions	Meets the product standard's requirements.
10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility. 10.10 Temperature rise The panel builder's responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility. 10.9.1 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder's responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.7 Internal electrical circuits and connectionsIs the panel builder's responsibility.10.8 Connections for external conductorsIs the panel builder's responsibility.10.9 Insulation propertiesIs the panel builder's responsibility.10.9.2 Power-frequency electric strengthIs the panel builder's responsibility.10.9.3 Impulse withstand voltageIs the panel builder's responsibility.10.9.4 Testing of enclosures made of insulating materialIs the panel builder's responsibility.10.10 Temperature riseIs the panel builder is responsibility.10.11 Short-circuit ratingIs the panel builder's responsibility. The specifications for the switchgear must be observed.10.12 Electromagnetic compatibilityIs the panel builder's responsibility. The specifications for the switchgear must be observed.10.13 Mechanical functionThe device meets the requirements, provide the information in the instruction	10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder is responsibility. 10.11 Short-circuit rating Is the panel builder is responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder is responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.9 Insulation properties Image: Constraint of the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder is responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.9.2 Power-frequency electric strength Is the panel builder's responsibility. 10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder's responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provide the information in the instruction	10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage Is the panel builder's responsibility. 10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility. 10.10 Temperature rise The panel builder is responsibile for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.9 Insulation properties	
10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility. 10.10 Temperature rise Is the panel builder's responsibility. 10.11 Short-circuit rating Is the panel builder's responsibility. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provide the information in the instruction	10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.10 Temperature rise The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. 10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provide the information in the instruction	10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provide the information in the instruction	10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed. 10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.10 Temperature rise	
10.13 Mechanical function The device meets the requirements, provided the information in the instruction	10.11 Short-circuit rating	
	10.12 Electromagnetic compatibility	
	10.13 Mechanical function	


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Switch disconnector (EC000216)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Off-load switch, circuit breaker, control switch / Switch disconnector (ecl@ss10.0.1-27-37-14-03 [AKF060013]) Version as main switch Yes Version as maintenance-/service switch Yes Version as safety switch No Yes Version as emergency stop installation Version as reversing switch No Number of switches ٧ 400 Max. rated operation voltage Ue AC v 690 - 690 Rated operating voltage 160 Rated permanent current lu Α Rated permanent current at AC-23, 400 V А Rated permanent current at AC-21, 400 V А 0 Rated operation power at AC-3, 400 V kW 0 Rated short-time withstand current lcw kA 3.5 Rated operation power at AC-23, 400 V kW 90 Switching power at 400 V kW 0 kA 100 Conditioned rated short-circuit current Iq 3 Number of poles Number of auxiliary contacts as normally closed contact 0 Number of auxiliary contacts as normally open contact 0 Number of auxiliary contacts as change-over contact 0 Motor drive optional Yes Motor drive integrated No Voltage release optional Yes Device construction Built-in device fixed built-in technique Yes Suitable for ground mounting Suitable for front mounting 4-hole No

Suitable for front mounting centre	No
Suitable for distribution board installation	Yes
Suitable for intermediate mounting	Yes
Colour control element	Grey
Type of control element	Rocker lever
Interlockable	Yes
Type of electrical connection of main circuit	Screw connection
Degree of protection (IP), front side	IP20
Degree of protection (NEMA)	

Dimensions

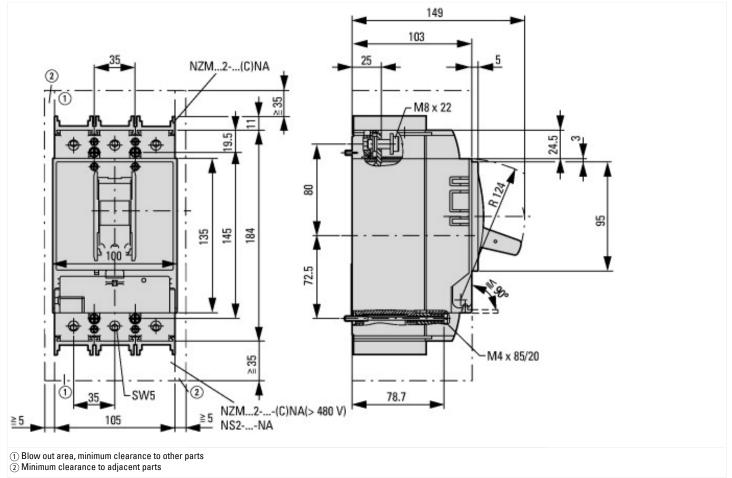

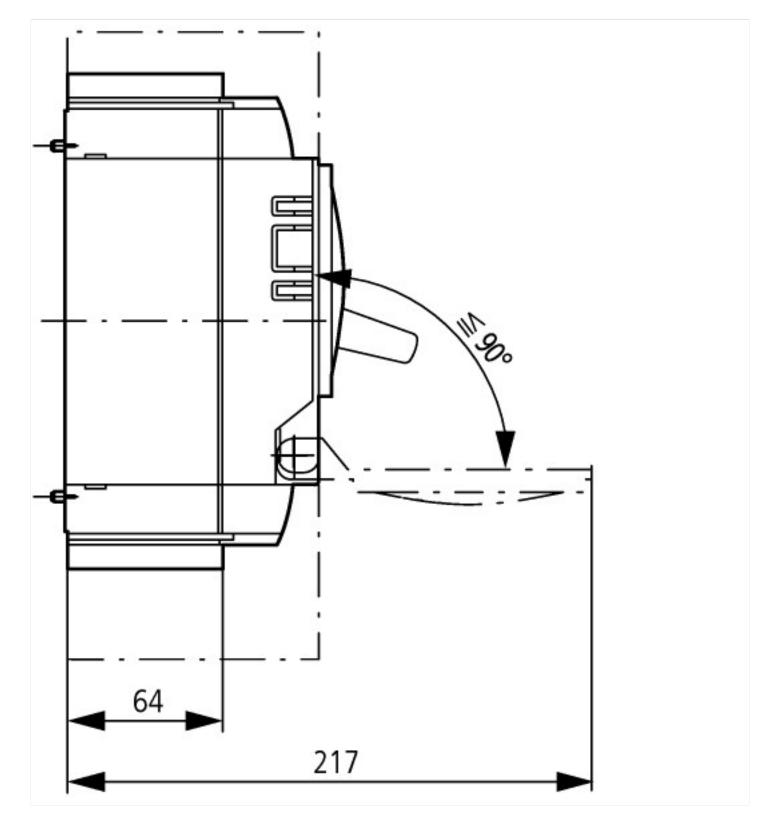

Additional product information (links)

IL01206012Z circuit-breaker LZMB2, switch-disconnector LN2

IL01206012Z circuit-breaker LZMB2, switch-disconnector LN2 https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01206012Z2017_05.pdf