DATASHEET - NZMB2-4-A250/160-SVE

Part no. Catalog No.



Circuit-breaker, 4p, 250A, 160A in 4th pole, plug-in module

NZMB2-4-A250/160-SVE 113216



Similar to illustration

Delivery program

Product rangeInterviewCircuit-breakerProtectionSoftem and cable protectionStandard ApprovalSoftem and cable protectionIstallation typeSoftem and cable protectionRelease systemSoftem and cable protectionRolese systemSoftem and cable protection sizeNumber of polesSoftem and cable protection sizeNumber of polesSoftem and cable protection synchronous with set value Ir of main pole.Number of polesSoftem and cable protection synchronous with set value Ir of main pole.Number of polesSoftem and cable protection synchronous with set value Ir of main pole.Number of polesSoftem and cable protection synchronous with set value Ir of main pole.Number of polesSoftem and cable protectionSoften and cable protectionSoftem and cable protectionNumber of polesSoftem and cable protectionNumber of polesSoftem and set of polesNumber of polesSoftem and set of polesNumber of polesSoftem and set of polesNumber of polesSoftem and set of				
Shadard/ApprovalFCECInstallation typePlug-in unitsRelease systemTermomagnetic releaseConstruction sizeVNZM2DescriptionVSet value in neural conductor is synchronous with set value Ir of main pole.Number of polesVVStandard squipmentVSer serve connectionSwitching capacityIServe connectionAd0/15 V50 HzIServe connectionReted current = rated uninterrupted currentIServeNeutral conductor protectionSer for serve connectionNeutral conductor protectionServeServeNeutral conductor protectionServeServeNeutral conductor protectionServeServeNeutral conductor protectionServeServeNeutral conductor protectionServeServeNeutral conductor protectionIServeNeutral conductor protectionIServeNeutral conductor protectionIServeNeutral conductor protectionIServeNeutral conductor protectionIServeNeutral conductor protectionIServeNeutral conductor protectionIServeImage: ServeIServeNumber of polesIServeServeServeServeNumber of polesIServeServeIServeNumber of polesIServeServeIServeServe	Product range			Circuit-breaker
Installation type Image in the second seco	Protective function			System and cable protection
Release systm Immoniagetic release Construction size NZM2 Description VZM2 Number of poles St value in neutral conductor is synchronous with set value Ir of main pole. Standard equipment Serve connection Storditing capacity Construction size 400/415 V 50 Hz Icu Rated current = rated uninterrupted current In= Hu A Rated current = rated uninterrupted current In= Hu A Neutral conductor protection In= Hu A Neutral conductor protection In= Hu A Neutral conductor protection In = Hu A Nain pole In = Hu A In in pole In = Hu A Short-circuit releases In = Hu A Short-cir	Standard/Approval			IEC
Construction size Image: Size Size Size value in neutral conductor is synchronous with set value Ir of main pole. Number of poles Verter Size 4 pole Standard equipment Screw connection Switching capacity Image: Size Screw connection 400/415 V 50 Hz Image: Size Screw connection Rated current = rated uninterrupted current Image: Size Screw connection Rated current = rated uninterrupted current Image: Size Screw connection Neutral conductor protection Image: Size Screw connection Neutral conductor protection Image: Size Screw connection Overload trip Image: Size Screw connection Stifting range: Size Image: Size Screw connection Numper Size Image: Size Image: Size Main pole Image: Size Image: Size Size Image: Size Image: Size Size Image: Size Image: Size Size Image: Size Image: Size Image: Size Image: Size Image: Size Size Image: Size Image: Size Image: Size Image: Size Image: Size Image: Size Image: Size Image: Size Image: Size <	Installation type			Plug-in units
Description Free Participant Set value in neutral conductor is synchronous with set value ir of main pole. Number of poles 4 pole Standard equipment Screw connection 400/415 V50 Hz Leu KA Added current = rated uninterrupted current Image: Set of the synchronous with set value ir of main pole. Rated current = rated uninterrupted current Image: Set of the synchronous with set value ir of main pole. Rated current = rated uninterrupted current Image: Set of the synchronous with set value ir of main pole. Reduced neutral conductor protection So of phase conductor So of the synchronous with set value ir of main pole. Neutral conductor protection So of phase conductor protection So of phase conductor protection So of phase conductor protection Setting range Image: Setting range Image: Setting range Image: Setting range Image: Setting range Image: Short-circuit releases	Release system			Thermomagnetic release
Number of poles Image: standard equipment Image: stan	Construction size			NZM2
Stadard equipment Image: Construction Switching capacity Icu Kau 400/415 V 50 Hz Icu Kau Rated current = rated uninterrupted current Icu Kau Rated current = rated uninterrupted current Icu Kau Rated current = rated uninterrupted current Icu Kau Neutral conductor No for bass So Reduced neutral conductor protection No Reduced neutral conductor protection Neutral conductor protection Icu Rated Overload trip Icu Icu Main pole Icu Icu Short-circuit releases Icu Icu Short-circuit releases Icu Icu	Description			Set value in neutral conductor is synchronous with set value Ir of main pole.
Switching capacityIcuIcuKat400/415 V 50 HzIcuKat5Rated current = rated uninterrupted currentIn = IA50Rated current = rated uninterrupted currentIn = IA50Neutral conductor% of phase MolucorA60Neutral conductor protectionABReduced neutral conductor protectionNeutral conductor protectionABFeduced neutral conductor protectionNeutral conductor protectionABSNeutral conductor protectionBFeduced neutral conductor protectionNeutral conductor protection </td <td>Number of poles</td> <td></td> <td></td> <td>4 pole</td>	Number of poles			4 pole
400/415 V 50 HzreuKA56Rated current = rated uninterrupted currentIn = IuNSoRated current = rated uninterrupted currentIn = IuASoNeutral conductorSo of of hase No of phase Neutral conductor protectionNoASoReduced neutral conductor protectionImage: Sol of the sol	Standard equipment			Screw connection
Rated current = rated uninterrupted current Image: Second control Image: Secon	Switching capacity			
Rated current = rated uninterrupted current In = Iu A 260 Neutral conductor Sociductor 60 Reduced neutral conductor protection A 100 Neutral conductor protection F F Neutral conductor protection F F Setting range F F Overload trip F F Image: Setting range F F Setting range F F <t< td=""><td>400/415 V 50 Hz</td><td>I_{cu}</td><td>kA</td><td>25</td></t<>	400/415 V 50 Hz	I _{cu}	kA	25
Neutral conductor % of phase conductor <td>Rated current = rated uninterrupted current</td> <td></td> <td></td> <td></td>	Rated current = rated uninterrupted current			
Image: Conductor Conductor A Beduced neutral conductor protection A Beduced neutral conductor protection Neutral conductor protection Image: Conductor protection Reduced neutral conductor protection Setting range: Conductor protection Image: Conductor protection Reduced neutral conductor protection Overload trip Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection Image: Conductor protection	Rated current = rated uninterrupted current	$I_n = I_u$	А	250
Neutral conductor protection Reduced neutral conductor protection Setting range Perform Reduced neutral conductor protection Overload trip Image: Perform Image: Perform Image: Perform	Neutral conductor		%	60
Setting range Image: Setting range Overload trip Image: Setting range Image: Short-circuit releases Image: Short-circuit releases	Reduced neutral conductor protection		А	160
Overload trip Ir A 200-250 Main pole Ir A 25 - 160 Short-circuit releases Ir Ir Ir	Neutral conductor protection			Reduced neutral conductor protection
Image: ProblemImage: ProblemProblemProblemProblemMain poleImage: ProblemImage: ProblemImage: ProblemImage: ProblemShort-circuit releasesImage: ProblemImage: ProblemImage: Problem	Setting range			
Main pole Ir A 125 - 160 Short-circuit releases Ir Ir Ir	Overload trip			
Short-circuit releases	द	l _r	A	200 - 250
	Main pole	l _r	A	125 - 160
Non-delayed I _i = I _n x 6 - 10				
	Non-delayed	l _i = l _n x		6 - 10

Technical data

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500
between the auxiliary contacts	V AC	300

Weight		kg	3.5
Mounting position		кy	3.5 Vertical and 90° in all directions
			With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers		٨	250
Rated current = rated uninterrupted current	I _n = I _u	A	250
Rated surge voltage invariability	U _{imp}		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	Ue	V AC	440
Overvoltage category/pollution degree			111/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems		V	≦ 440
Switching capacity Rated short-circuit making capacity	I _{cm}		
240 V	I _{cm}	kA	63
400/415 V		kA	53
440 V 50/60 Hz	I _{cm}	kA	53
	I _{cm}	KA .	
Rated short-circuit breaking capacity I _{cn}	I _{cn}	1.0	
Icu to IEC/EN 60947 test cycle O-t-CO	lcu	kA	20
240 V 50/60 Hz	I _{cu}	kA	30
400/415 V 50/60 Hz	I _{cu}	kA	25
440 V 50/60 Hz	l _{cu}	kA	25
Ics to IEC/EN 60947 test cycle 0-t-CO-t-CO	lcs	kA	
240 V 50/60 Hz	I _{cs}	kA	30
400/415 V 50/60 Hz	I _{cs}	kA	25
440 V 50/60 Hz	I _{cs}	kA	18.5
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical AC-1			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Screw connection
Accessories required			NZM2-4-XSVS
Optional accessories			Box terminal Tunnel terminal connection on rear

Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
1-hole		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 × 24 × 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min.	mm	16 x 5
	max.	mm	24 x 8
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

•			
Technical data for design verification			
Rated operational current for specified heat dissipation	I _n	А	250
Equipment heat dissipation, current-dependent	P _{vid}	W	58.13
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.


10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

A	250
V	440 - 440
kA	25
А	200 - 250
А	0 - 0
A	6 - 10
	No
	Screw connection
	Built-in device plug-in technique
	No
	Yes
	0
	0
	0
	No
	No
	4
	Front side
	Rocker lever
	Yes
	No
	Yes
	IP20
	V kA A A

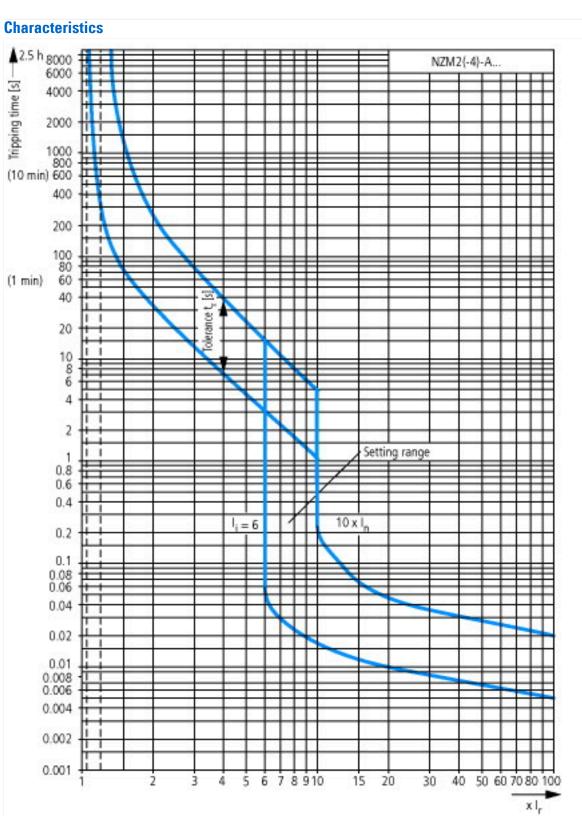


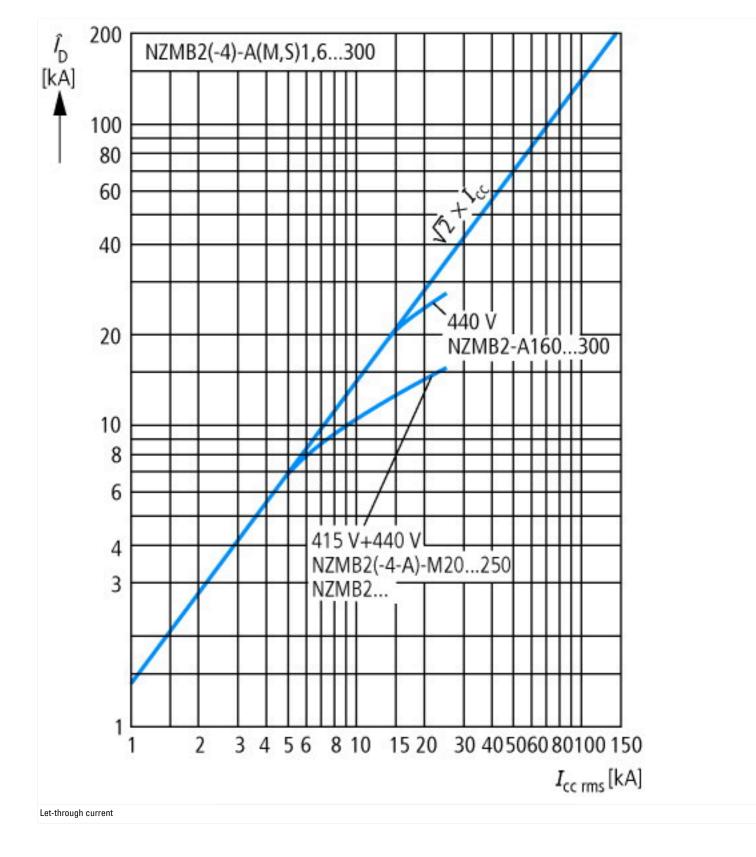


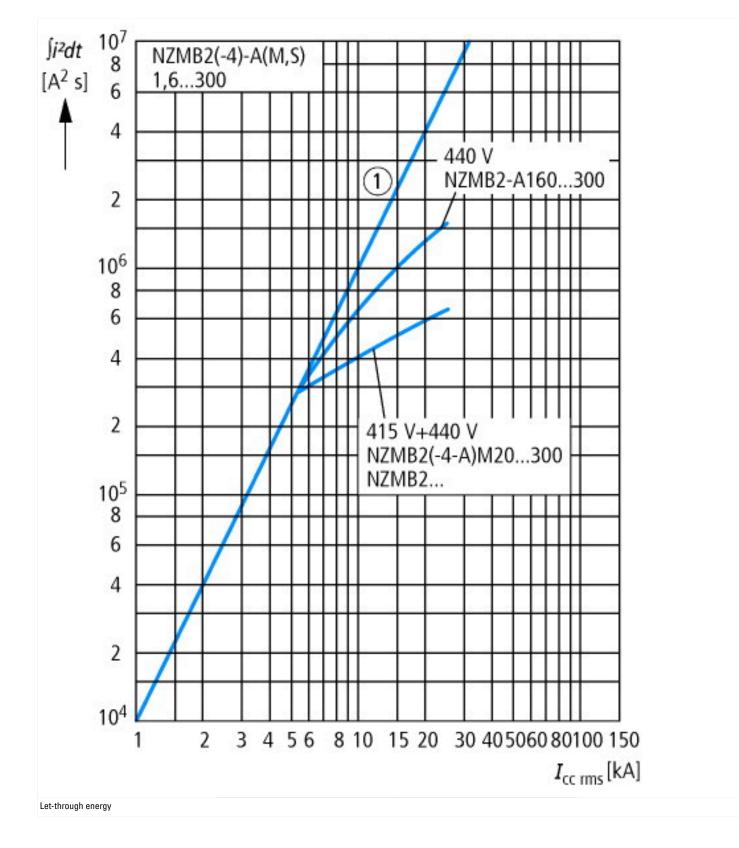

02/17/2021



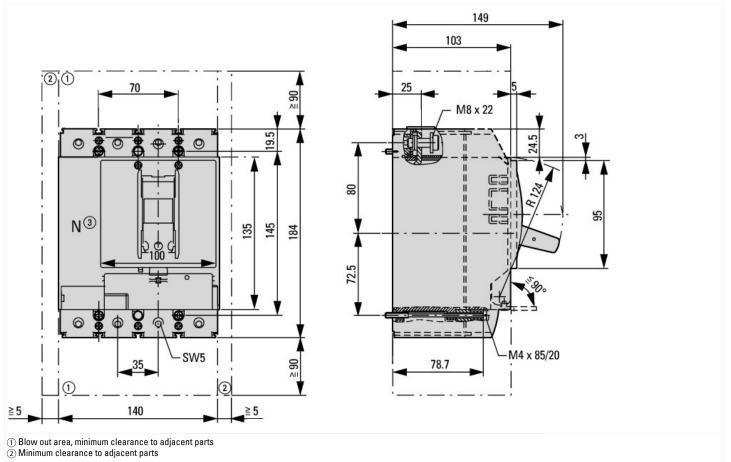

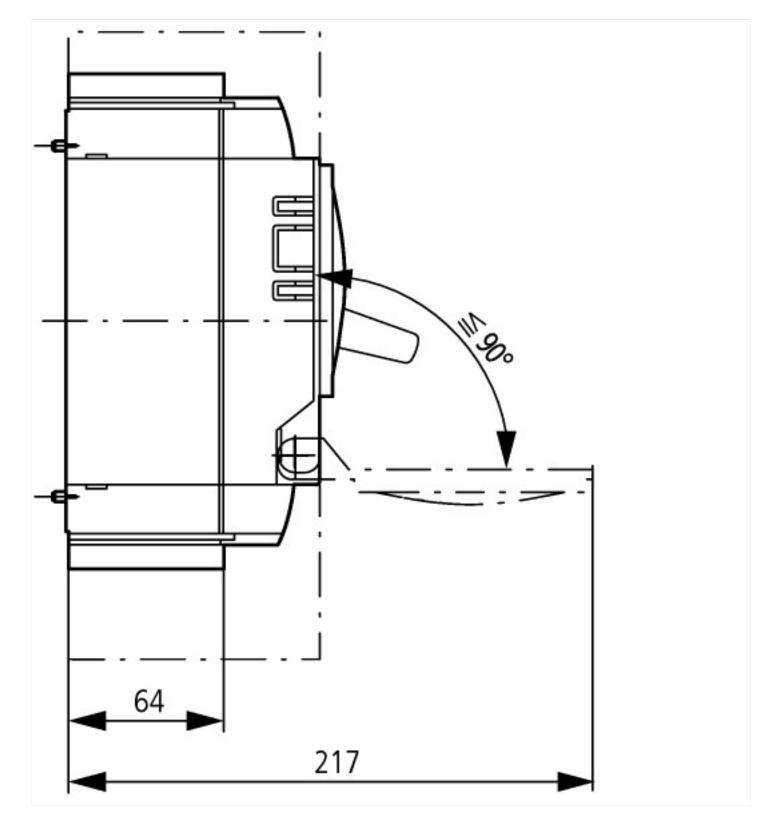

Additional product information (links)

Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/ index.htm
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf