DATASHEET - NZMN2-A250-SVE



Circuit-breaker, 3p, 250A, plug-in module

Part no. NZMN2-A250-SVE Catalog No. 113246

EL-Nummer (Norway)

0004357015




Similar to illustration

| Delivery program | | | |
|---|--------------------------|----|-----------------------------|
| Product range | | | Circuit-breaker |
| Protective function | | | System and cable protection |
| Standard/Approval | | | IEC |
| Installation type | | | Plug-in units |
| Release system | | | Thermomagnetic release |
| Construction size | | | NZM2 |
| Number of poles | | | 3 pole |
| Standard equipment | | | Screw connection |
| Switching capacity | | | |
| 400/415 V 50 Hz | I _{cu} | kA | 50 |
| Rated current = rated uninterrupted current | | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 250 |
| Setting range | | | |
| Overload trip | | | |
| 中 | I _r | Α | 200 - 250 |
| Short-circuit releases | | | |
| Non-delayed | $I_i = I_n \times \dots$ | | 6 - 10 |

Technical data

| General | | |
|---|------|--|
| Standards | | IEC/EN 60947 |
| Protection against direct contact | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | |
| Ambient temperature, storage | °C | - 40 - + 70 |
| Operation | °C | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | |
| Between auxiliary contacts and main contacts | V AC | 500 |
| between the auxiliary contacts | V AC | 300 |
| Weight | kg | 2.345 |
| Mounting position | | Vertical and 90° in all directions |



With XFI earth-fault release:
- NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit
- NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit:
- NZM3, N3: vertical, 90° right/left
- NZM4, N4: vertical

with remote operator:
- NZM2, N(S)2, NZM3, N(S)3,
NZM4, N(S)4: vertical and 90° in all directions

| Direction of incoming supply | as required |
|--|---|
| Degree of protection | |
| Device | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | With insulating surround: IP40 With door coupling rotary handle: IP66 |
| Terminations | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) | Temperature dependency, Derating |
| Circuit brookers | |

Circuit-breakers

| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 250 |
|---|----------------|------|-------|
| Rated surge voltage invariability | U_{imp} | | |
| Main contacts | | V | 8000 |
| Auxiliary contacts | | V | 6000 |
| Rated operational voltage | U _e | V AC | 690 |
| Overvoltage category/pollution degree | | | III/3 |
| Rated insulation voltage | Ui | V | 1000 |
| Use in unearthed supply systems | | V | ≦ 690 |

400 V 50/60 Hz

| Switching capacity | | | |
|---|-----------------|----|---|
| Rated short-circuit making capacity | I _{cm} | | |
| 240 V | I _{cm} | kA | 187 |
| 400/415 V | I _{cm} | kA | 105 |
| 440 V 50/60 Hz | I _{cm} | kA | 74 |
| 525 V 50/60 Hz | I _{cm} | kA | 53 |
| 690 V 50/60 H | Ic | kA | 40 |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | | |
| Icu to IEC/EN 60947 test cycle 0-t-C0 | Icu | kA | |
| 240 V 50/60 Hz | I _{cu} | kA | 85 |
| 400/415 V 50/60 Hz | I _{cu} | kA | 50 |
| 440 V 50/60 Hz | I _{cu} | kA | 35 |
| 525 V 50/60 Hz | I _{cu} | kA | 25 |
| 690 V 50/60 Hz | I _{cu} | kA | 20 |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | Ics | kA | |
| 240 V 50/60 Hz | I _{cs} | kA | 85 |
| 400/415 V 50/60 Hz | I _{cs} | kA | 50 |
| 440 V 50/60 Hz | I _{cs} | kA | 35 |
| 525 V 50/60 Hz | I _{cs} | kA | 25 |
| 690 V 50/60 Hz | I _{cs} | kA | 5 |
| | | | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Rated short-time withstand current | | | |
| t = 0.3 s | I _{cw} | kA | 1.9 |
| t = 1 s | I _{cw} | kA | 85 |
| Utilization category to IEC/EN 60947-2 | | | A |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | | 20000 |
| Lifespan, electrical | | | |
| ΔΓ-1 | | | |

Operations

10000

| 690 V 50/60 Hz Opera AC3 400 V 50/60 Hz Opera 415 V 50/60 Hz Opera | m | 7 6 6 6 5 5 5 5 5 5 6 6 6 6 6 6 6 6 6 6 | 10000 7500 6500 6500 5000 120 < 10 Screw connection NZM2-XSVS Box terminal Tunnel terminal |
|--|------------------|---|--|
| AC3 400 V 50/60 Hz Opera 415 V 50/60 Hz Opera 690 V 50/60 Hz Max. operating frequency Total break time at short-circuit Terminal capacity Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | ations ations or | 6 6 6 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 | 6500 6500 5000 120 < 10 Screw connection NZM2-XSVS Box terminal Tunnel terminal |
| 400 V 50/60 Hz 415 V 50/60 Hz 690 V 50/60 Hz Max. operating frequency Total break time at short-circuit Terminal capacity Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | ations ations Op | 6 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 | 6500 5000 120 < 10 Screw connection NZM2-XSVS Box terminal Tunnel terminal |
| 415 V 50/60 Hz 690 V 50/60 Hz Opera Max. operating frequency Total break time at short-circuit Terminal capacity Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | ations ations Op | 6 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5 | 6500 5000 120 < 10 Screw connection NZM2-XSVS Box terminal Tunnel terminal |
| 690 V 50/60 Hz Max. operating frequency Total break time at short-circuit Terminal capacity Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | ations Opm | E E E E E E E E E E E E E E E E E E E | 5000 120 < 10 Screw connection NZM2-XSVS Box terminal Tunnel terminal |
| Max. operating frequency Total break time at short-circuit Terminal capacity Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | O _I | Ops/h 1 ns < | 120 < 10 Screw connection NZM2-XSVS Box terminal Tunnel terminal |
| Total break time at short-circuit Terminal capacity Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | m | ns < | < 10 Screw connection NZM2-XSVS Box terminal Tunnel terminal |
| Terminal capacity Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | | \$ M E | Screw connection NZM2-XSVS Box terminal Tunnel terminal |
| Standard equipment Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | mi | P E 1 | NZM2-XSVS Box terminal Tunnel terminal |
| Accessories required Optional accessories Round copper conductor Box terminal Solid Stranded | mi | P E 1 | NZM2-XSVS Box terminal Tunnel terminal |
| Optional accessories Round copper conductor Box terminal Solid Stranded | mi | E 1 | Box terminal Tunnel terminal |
| Round copper conductor Box terminal Solid Stranded | mı | 1 | Tunnel terminal |
| Box terminal Solid Stranded | mı | | connection on rear |
| Solid Stranded | mı | | |
| Stranded | mı | | |
| | | | 1 x (10 - 16) 2 x (6 - 16) |
| Tunnel terminal | mı | | 1 x (25 - 185) 2 x (25 - 70) |
| Tullilet terminal | | | |
| Solid | mı | nm ² 1 | 1 x 16 |
| Stranded | | | |
| 1-hole | mı | nm ² 1 | 1 x (25 - 185) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | mı | | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | mı | nm ² 1 | 1 x (25 - 185) 2 x (25 - 70) |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Solid | mı | nm ² 1 | 1 x 16 |
| Stranded | | | |
| Stranded | mı | nm ² 1 | 1 x (25 - 185) |
| Cu strip (number of segments x width x segment thickness) | "" | | |
| Box terminal | | | |
| min. | mı | nm 2 | 2 x 9 x 0.8 |
| max. | | | 10 x 16 x 0.8 |
| III. | | | (2x) 8 x 15.5 x 0,8 |
| Bolt terminal and rear-side connection | | | |
| Flat copper strip, with holes min. | mı | nm 2 | 2 x 16 x 0.8 |
| Flat copper strip, with holes max. | mı | nm 1 | 10 x 24 x 0.8 |
| Copper busbar (width x thickness) mm | | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | N | M8 |
| Direct on the switch | | | |
| min. | mı | nm 1 | 16 x 5 |
| max. | mı | nm 2 | 24 x 8 |
| Control cables | | | |
| | | nm ² 1 | 1 x (0.75 - 2.5) |

Design verification as per IEC/EN 61439

| Technical data for design verification | | | |
|--|------------------|----|-------|
| Rated operational current for specified heat dissipation | In | Α | 250 |
| Equipment heat dissipation, current-dependent | P_{vid} | W | 58.13 |
| Operating ambient temperature min. | | °C | -25 |


| Operating ambient temperature max. | °C | 70 |
|--|----|--|
| EC/EN 61439 design verification | | |
| 10.2 Strength of materials and parts | | |
| 10.2.2 Corrosion resistance | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | |
| 10.9.2 Power-frequency electric strength | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | Is the panel builder's responsibility. The specifications for the switch gear must b observed. $\label{eq:controller}$ |
| 10.12 Electromagnetic compatibility | | Is the panel builder's responsibility. The specifications for the switch gear must b observed. $\label{eq:builder}$ |
| 10.13 Mechanical function | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |
| | | |


Technical data ETIM 7.0


 $Low-voltage\ industrial\ components\ (EG000017)\ /\ Power\ circuit-breaker\ for\ trafo/generator/installation\ protection\ (EC000228)$

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


| protection (eci@ss10.0.1-2/-3/-04-09 [AJZ/16013]) | | |
|---|----|-----------------------------------|
| Rated permanent current lu | Α | 250 |
| Rated voltage | V | 690 - 690 |
| Rated short-circuit breaking capacity Icu at 400 V, 50 Hz | kA | 50 |
| Overload release current setting | Α | 200 - 250 |
| Adjustment range short-term delayed short-circuit release | Α | 0 - 0 |
| Adjustment range undelayed short-circuit release | Α | 1500 - 2500 |
| Integrated earth fault protection | | No |
| Type of electrical connection of main circuit | | Screw connection |
| Device construction | | Built-in device plug-in technique |
| Suitable for DIN rail (top hat rail) mounting | | No |
| DIN rail (top hat rail) mounting optional | | Yes |
| Number of auxiliary contacts as normally closed contact | | 0 |
| Number of auxiliary contacts as normally open contact | | 0 |
| Number of auxiliary contacts as change-over contact | | 0 |
| With switched-off indicator | | No |
| With under voltage release | | No |
| Number of poles | | 3 |
| Position of connection for main current circuit | | Front side |
| Type of control element | | Rocker lever |
| Complete device with protection unit | | Yes |
| Motor drive integrated | | No |
| Motor drive optional | | Yes |
| Degree of protection (IP) | | IP20 |
| | | |

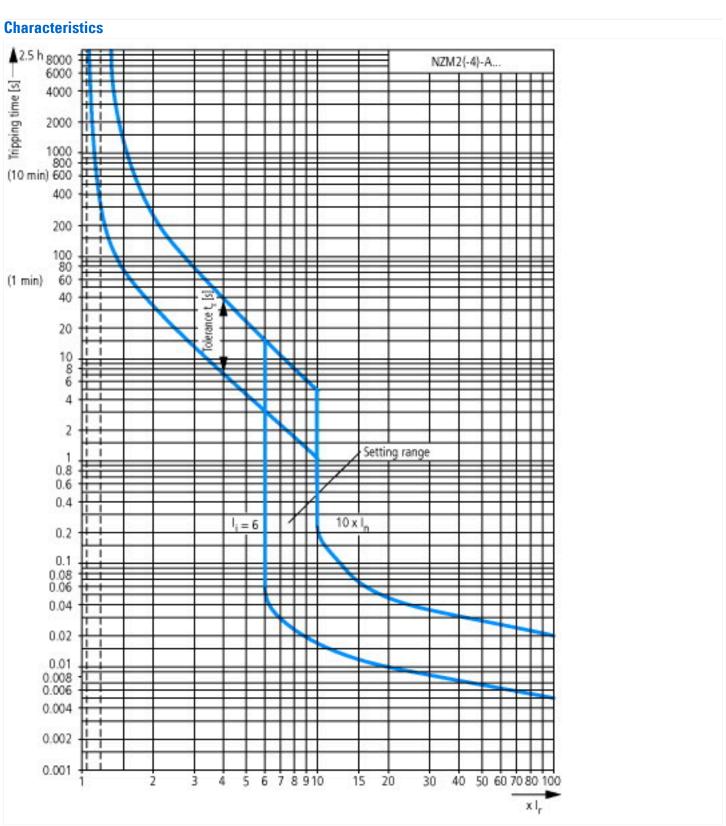

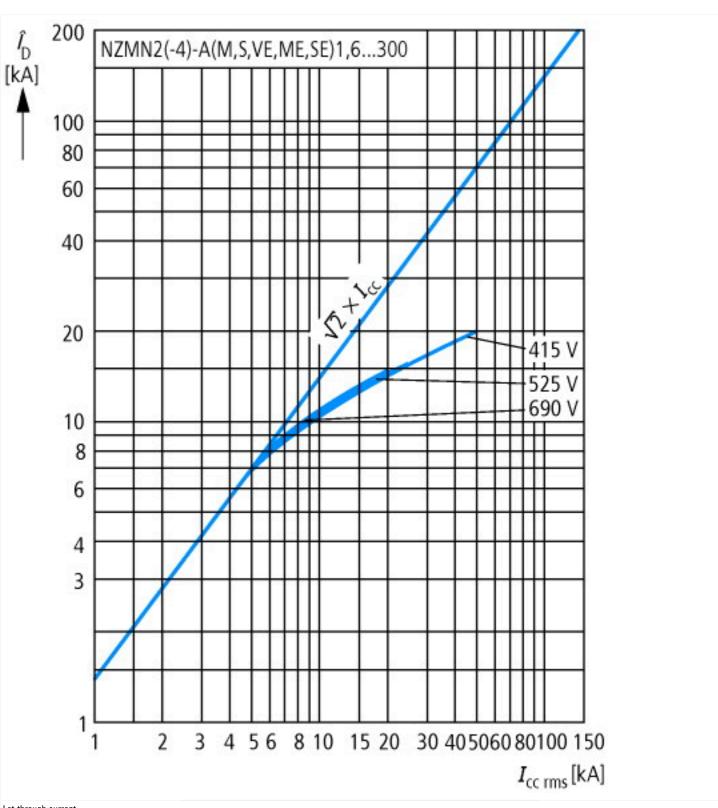


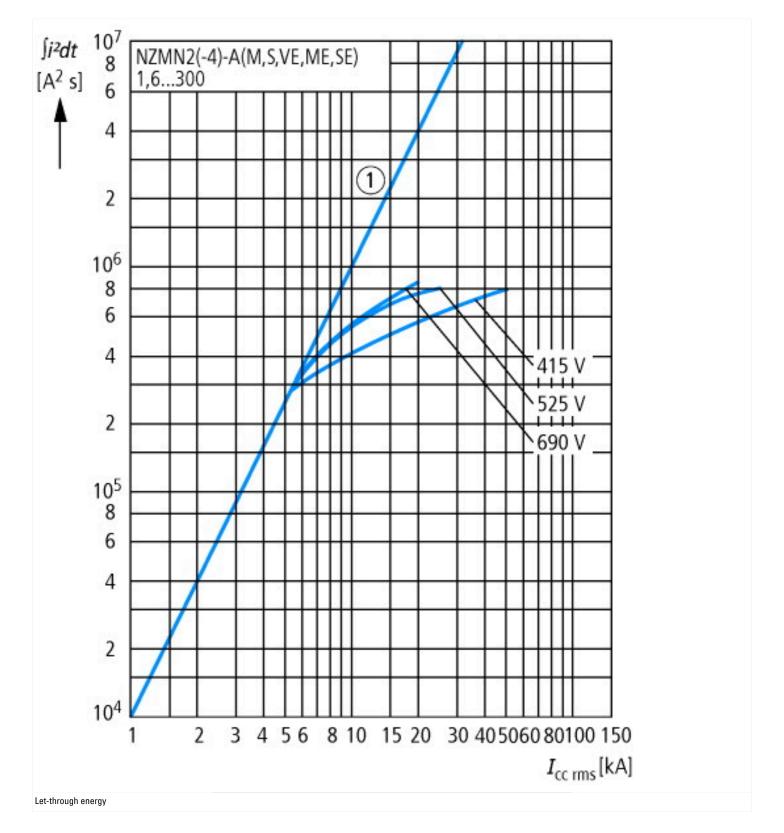

Dimensions

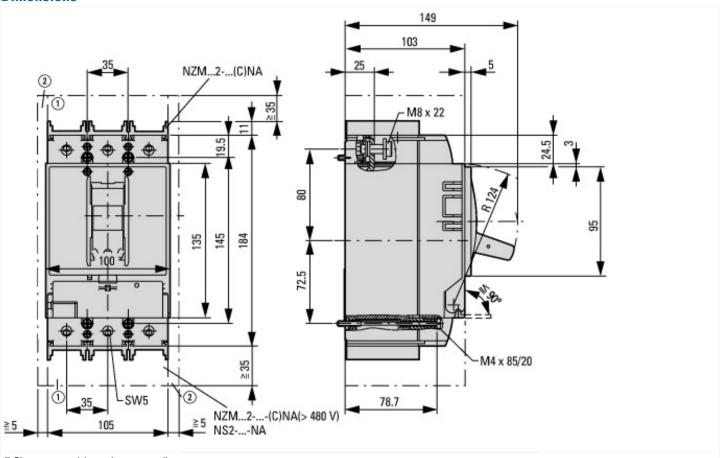

- Blow out area, minimum clearance to adjacent parts
 Minimum clearance to adjacent parts

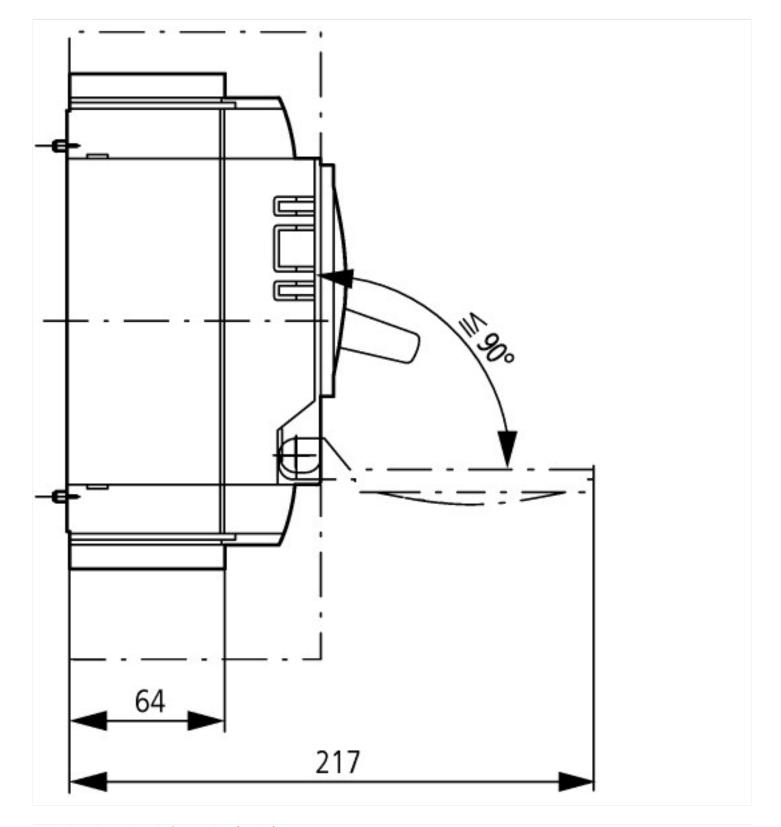

Additional product information (links)

| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 |
|---|--|
| CurveSelect characteristics program | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm |
| additional technical information for NZM power switch | https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf |