DATASHEET - NZMN3-4-AE400/250-T-AVE

Part no.



Circuit-breaker, 4p, 400A, 250A in 4th pole, withdrawable unit

NZMN3-4-AE400/250-T-AVE Catalog No. 113539



Similar to illustration

Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
nstallation type			Withdrawable
Release system			Electronic release
Construction size			NZM3
Description			Set value in neutral conductor is synchronous with set value Ir of main pole. R.m.s. value measurement and "thermal memory" Earth-fault release: Not dependent on mains and control voltages $ lg = 0.35 - 0.4 - 0.5 - 0.6 - 0.7 - 0.8 - 0.9 - 1.0 \times ln $
Number of poles			4 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	50
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	400
Neutral conductor	% of phase conductor	%	60
Reduced neutral conductor protection		Α	250
Neutral conductor protection			Reduced neutral conductor protection
Setting range			
Overload trip			
4	I _r	Α	200 - 400
Main pole	l _r	А	125 - 250
Short-circuit releases			
Non-delayed	$I_i = I_n \times \dots$		2 - 11

Technical data

delleral		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)

Safe isolation to EN 61140				
Between auxiliary contacts and main contacts		V AC	500	
between the auxiliary contacts		V AC	300	
Weight		kg	8.4	
Mounting position			Vertical and 90° in all directions	With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required	
Degree of protection				
Device			In the operating controls area: IP2	20 (basic degree of protection)
Enclosures Terminations			With insulating surround: IP40 With door coupling rotary handle: Tunnel terminal: IP10 Phase isolator and strip terminal:	IP00
Other technical data (sheet catalogue)			Temperature dependency, Deratir	ng
Circuit-breakers Rated current = rated uninterrupted current	$I_n = I_u$	Α	400	
Rated surge voltage invariability	U _{imp}			
Main contacts	Oimp	V	8000	
Auxiliary contacts		V	6000	
Rated operational voltage	U _e	V AC	690	
	O _e	V AC		
Overvoltage category/pollution degree		V	111/3	
Rated insulation voltage	Ui		1000	
Use in unearthed supply systems Switching capacity		V	≦ 690	
Rated short-circuit making capacity	I _{cm}			
240 V	I _{cm}	kA	187	
400/415 V	I _{cm}	kA	105	
440 V 50/60 Hz	I _{cm}	kA	74	
525 V 50/60 Hz		kA	53	
· · · · · · · · · · · · · · · · · · ·	I _{cm}		40	
690 V 50/60 H Rated short-circuit breaking capacity I _{cn}	Ic	kA	40	
	I _{cn}			
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	OE.	
240 V 50/60 Hz	I _{cu}	kA	85	
400/415 V 50/60 Hz	I _{cu}	kA	50	
440 V 50/60 Hz	I _{cu}	kA	35	
525 V 50/60 Hz	I _{cu}	kA	25	
690 V 50/60 Hz	I _{cu}	kA	20	
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA		
240 V 50/60 Hz	I _{cs}	kA	85	
400/415 V 50/60 Hz	I _{cs}	kA	50	
440 V 50/60 Hz	I _{cs}	kA	35	
525 V 50/60 Hz	I _{cs}	kA	13	
690 V 50/60 Hz	I _{cs}	kA	5 Maximum back-up fuse, if the exp location exceed the switching cap	nected short-circuit currents at the installation pacity of the circuit-breaker.
Rated short-time withstand current				
t = 0.3 s	I _{cw}	kA	3.3	
t = 1 s	I _{cw}	kA	3.3	

Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		15000
Lifespan, electrical	·		
AC-1			
400 V 50/60 Hz	Operations		5000
415 V 50/60 Hz	Operations		5000
690 V 50/60 Hz	Operations		3000
AC3			
400 V 50/60 Hz	Operations		2000
415 V 50/60 Hz	Operations		2000
690 V 50/60 Hz	Operations		2000
Max. operating frequency		Ops/h	60
Total break time at short-circuit		ms	<10
Terminal capacity		IIIO	
Standard equipment			Screw connection
Accessories required			NZM3-4-XAVS
Optional accessories			Box terminal Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	2 x 16
Stranded		mm ²	1 x (35 - 240) 2 x (25-120)
Tunnel terminal			
Solid		mm^2	1 x 16
Stranded			
1-hole		mm ²	1 x (16 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x 16
			2 x 16
Stranded		mm ²	1 x (25 - 240) 2 x (25 - 240)
Connection width extension		mm ²	
Connection width extension		mm^2	2 x 300
Al circular conductor			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185) ²⁾
Double hole			1 x (50 - 240)
Double Hole		mm ²	2 x (50 - 240)
			²⁾ Up to 240 mm ² can be connected depending on the cable manufacturer.
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	6 x 16 x 0.8
	max.	mm	10 x 24 x 1.0 + 5 x 24 x 1.0 (2 x) 8 x 24 x 1.0
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	6 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 32 x 1.0 + 5 x 32 x 1.0
Connection width extension		mm	(2 x) 10 x 50 x 1.0
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M10

Direct on the switch			
	min.	mm	20 x 5
	max.	mm	30 x 10 + 30 x 5
Connection width extension		mm	
Connection width extension	max.	mm	2 x (10 x 50)
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	400
Equipment heat dissipation, current-dependent	P _{vid}	W	96.48
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects $\frac{1}{2} = \frac{1}{2} \left(\frac{1}{2} + \frac{1}{2} \right) \left(\frac{1}{2} + \frac{1}{2} + \frac{1}{2} \right) \left(\frac{1}{2} + \frac{1}$			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


protection (eci@ss10.0.1-2/-3/-04-09 [AJZ/16013])		
Rated permanent current lu	А	400
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	50
Overload release current setting	Α	200 - 400
Adjustment range short-term delayed short-circuit release	А	0 - 0
Adjustment range undelayed short-circuit release	А	800 - 4400
Integrated earth fault protection		Yes
Type of electrical connection of main circuit		Screw connection

Device construction	Built-in device slide-in technique (withdrawable)
Suitable for DIN rail (top hat rail) mounting	No
DIN rail (top hat rail) mounting optional	No
Number of auxiliary contacts as normally closed contact	0
Number of auxiliary contacts as normally open contact	0
Number of auxiliary contacts as change-over contact	0
With switched-off indicator	No
With under voltage release	No
Number of poles	4
Position of connection for main current circuit	Front side
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20

Characteristics

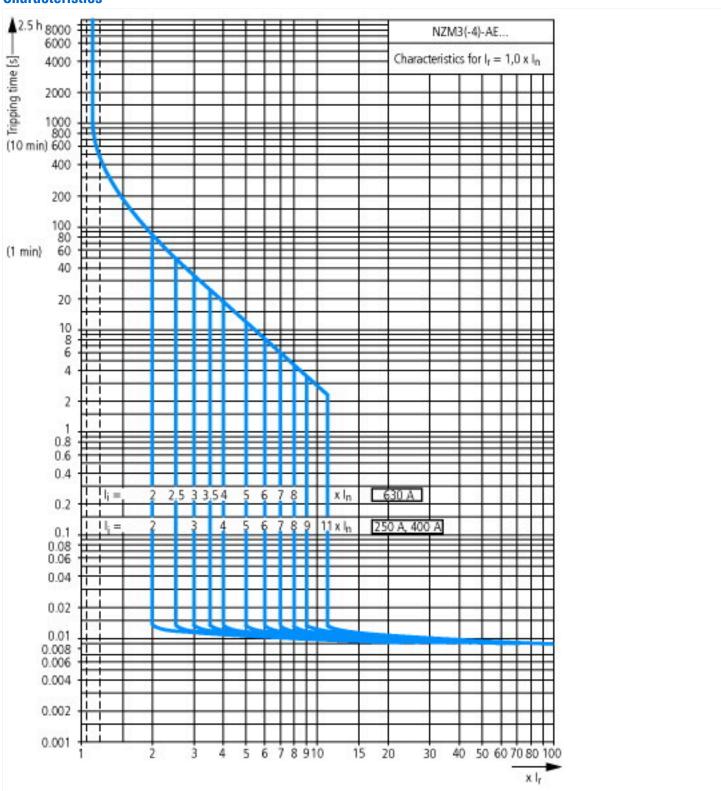


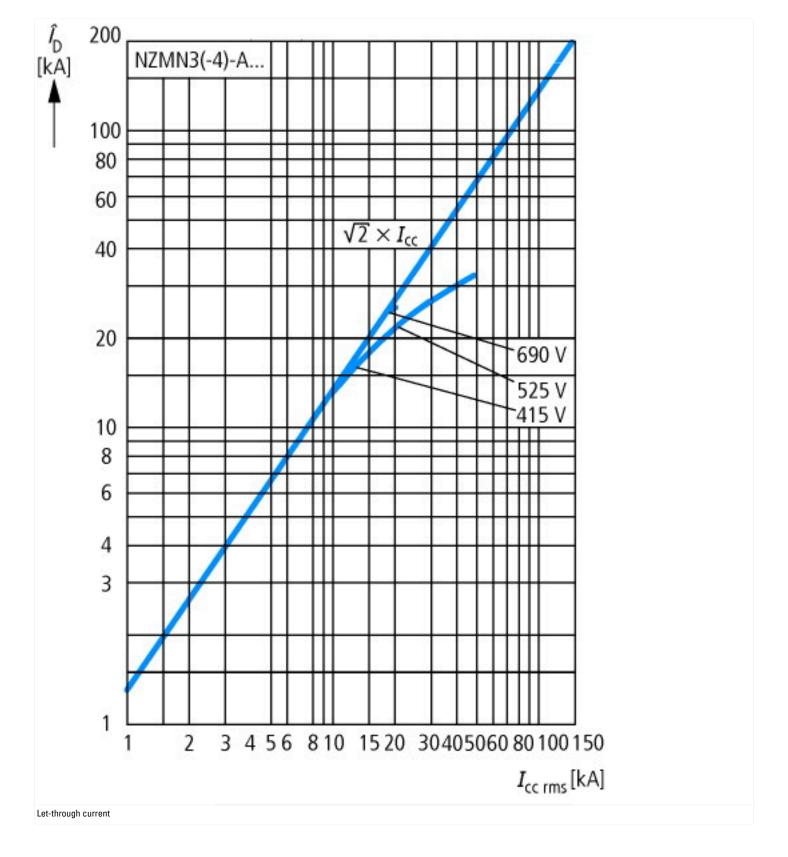


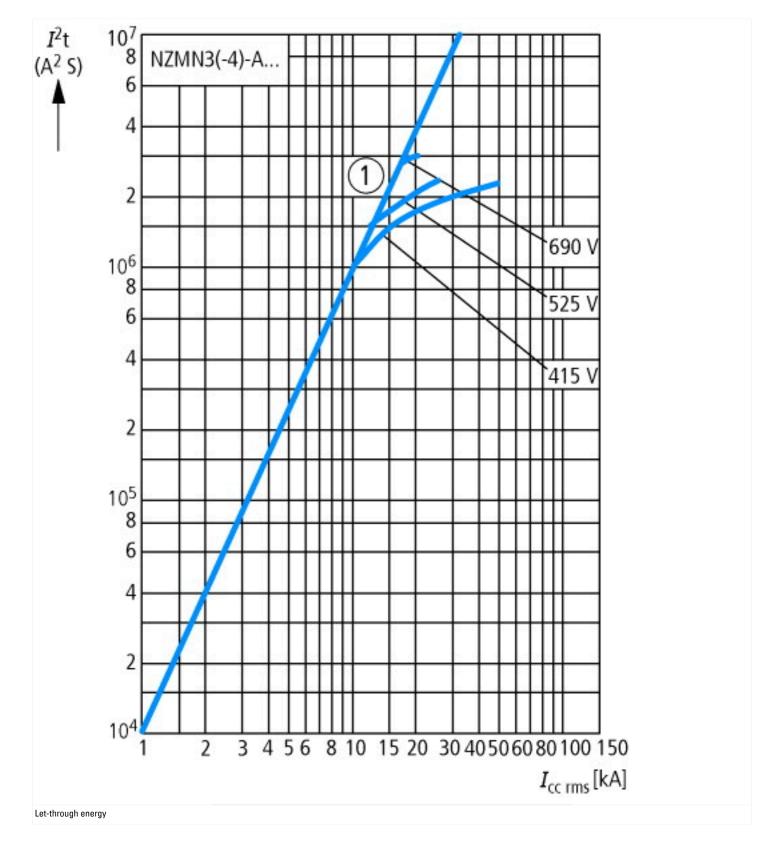

Eaton 113539 ED2021 V76.0 EN

Dimensions

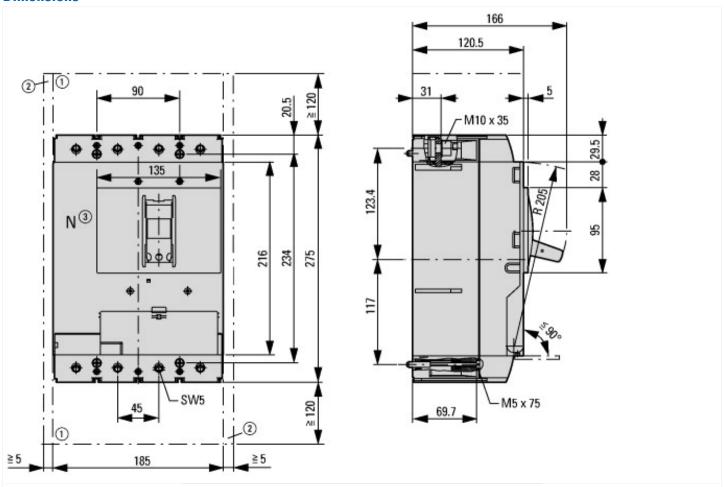

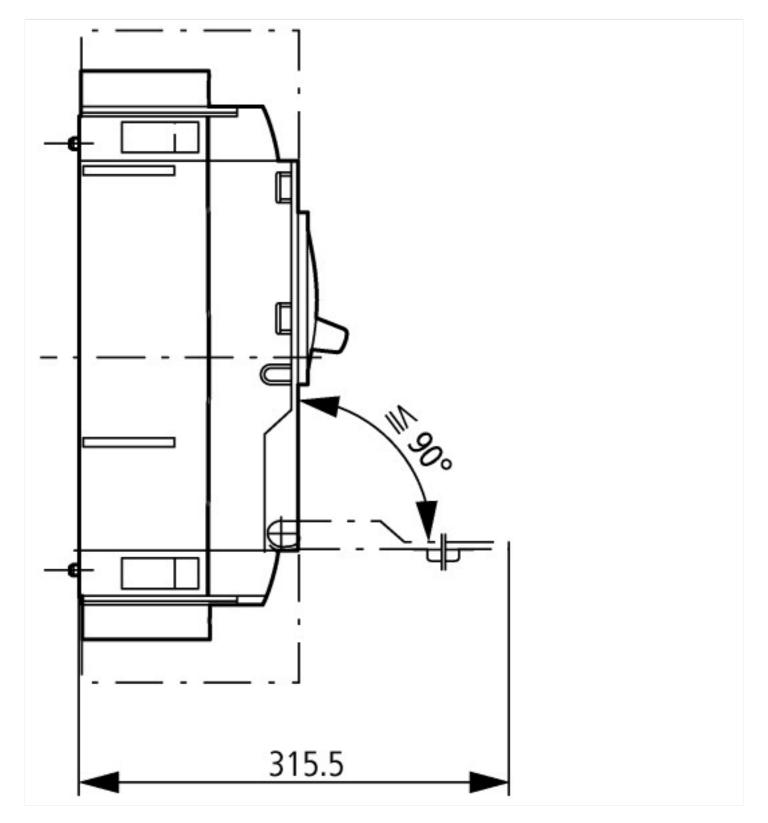

Additional product information (links)

The state of the s	
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf