### DATASHEET - NZMN3-4-AE630/400-AVE

Part no.

Catalog No.



### Circuit-breaker, 4p, 630A, 400A in 4th pole, withdrawable unit

NZMN3-4-AE630/400-AVE 113544



Similar to illustration

Daliyary program			
Delivery program Product range			Circuit-breaker
Protective function			
			System and cable protection  IEC
Standard/Approval			
Installation type			Withdrawable
Release system			Electronic release
Construction size			NZM3
Description			Set value in neutral conductor is synchronous with set value Ir of main pole. R.m.s. value measurement and "thermal memory"
Number of poles			4 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I <sub>cu</sub>	kA	50
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	630
Neutral conductor	% of phase conductor	%	60
Reduced neutral conductor protection		Α	400
Neutral conductor protection			Reduced neutral conductor protection
Setting range			
Overload trip			
中	l <sub>r</sub>	Α	315 - 630
Main pole	l <sub>r</sub>	Α	200 - 400
Short-circuit releases			
Non-delayed	$I_i = I_n \times \dots$		2 - 8

#### **Technical data**

General

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500

between the auxiliary contacts		V AC	300	
Weight		kg	8.4	
Mounting position			Vertical and 90° in all directions	With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required	
Degree of protection				
Device			In the operating controls area: IP2	20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle:	IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: I	IP00
Other technical data (sheet catalogue)  Circuit-breakers			Temperature dependency, Deratin	g
Rated current = rated uninterrupted current	$I_n = I_u$	Α	630	
Rated surge voltage invariability	U <sub>imp</sub>			
Main contacts		V	8000	
Auxiliary contacts		V	6000	
Rated operational voltage	U <sub>e</sub>	V AC	690	
Overvoltage category/pollution degree			III/3	
Rated insulation voltage	Ui	V	1000	
Use in unearthed supply systems		V	≦ 690	
Switching capacity				
Rated short-circuit making capacity	I <sub>cm</sub>			
240 V	I <sub>cm</sub>	kA	187	
400/415 V	I <sub>cm</sub>	kA	105	
440 V 50/60 Hz	I <sub>cm</sub>	kA	74	
525 V 50/60 Hz	I <sub>cm</sub>	kA	53	
690 V 50/60 H	Ic	kA	40	
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>			
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA		
240 V 50/60 Hz	I <sub>cu</sub>	kA	85	
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	50	
440 V 50/60 Hz	I <sub>cu</sub>	kA	35	
525 V 50/60 Hz	I <sub>cu</sub>	kA	25	
690 V 50/60 Hz	I <sub>cu</sub>	kA	20	
lcs to IEC/EN 60947 test cycle O-t-CO-t-CO	Ics	kA		
240 V 50/60 Hz	I <sub>cs</sub>	kA	85	
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	50	
440 V 50/60 Hz	I <sub>cs</sub>	kA	35	
525 V 50/60 Hz	I <sub>cs</sub>	kA	13	
690 V 50/60 Hz	I <sub>cs</sub>	kA	5	
			Maximum back-up fuse, if the exp location exceed the switching cap	ected short-circuit currents at the installation pacity of the circuit-breaker.
Rated short-time withstand current				
t = 0.3 s	I <sub>cw</sub>	kA	3.3	
t = 1 s	I <sub>cw</sub>	kA	3.3	
Utilization category to IEC/EN 60947-2			Α	
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		15000	

Operations		5000
		5000
Operations		3000
Operations		2000
		2000
Operations		2000
	Ops/h	60
	ms	< 10
		Screw connection
		NZM3-4-XAVS
		Box terminal Tunnel terminal connection on rear
	$mm^2$	2 x 16
	mm <sup>2</sup>	1 x (35 - 240) 2 x (25-120)
		4.40
	mm <sup>2</sup>	1 x 16
	mm <sup>2</sup>	1 x (16 - 185)
	mm <sup>2</sup>	1 x 16 2 x 16
	mm <sup>2</sup>	1 x (25 - 240) 2 x (25 - 240)
	mm <sup>2</sup>	
	$mm^2$	2 x 300
	mm <sup>2</sup>	1 x 16
	mm <sup>2</sup>	1 x (25 - 185) <sup>2)</sup>
	mm <sup>2</sup>	1 x (50 - 240) 2 x (50 - 240)
		<ul> <li>Up to 240 mm² can be connected depending on the cable manufacturer.</li> </ul>
		ορ το 240 mm. can be connected depending on the cable manufacturef.
min	mm	6 x 16 x 0.8
		10 x 24 x 1.0
mux.		+ 5 x 24 x 1.0 (2 x) 8 x 24 x 1.0
min.	mm	6 x 16 x 0.8
max.	mm	10 x 32 x 1.0 + 5 x 32 x 1.0
	mm	(2 x) 10 x 50 x 1.0
mm		
		M10
	Operations Operations Operations  min. max.	Operations Operations Operations Operations Operations Operations Operations  Ops/h ms  mm² mm² mm² mm² mm² mm² mm² mm² mm²

	max.	mm	30 x 10 + 30 x 5
Connection width extension		mm	
Connection width extension	max.	mm	2 x (10 x 50)
Control cables			
		mm <sup>2</sup>	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

## **Design verification as per IEC/EN 61439**

Design vermoation as per illo/liv 01433			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	630
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	178.61
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

#### **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])	3,7	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
Rated permanent current lu	Α	630
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	50
Overload release current setting	Α	315 - 630
Adjustment range short-term delayed short-circuit release	Α	0 - 0
Adjustment range undelayed short-circuit release	Α	1260 - 5040
Integrated earth fault protection		No
Type of electrical connection of main circuit		Screw connection
Device construction		Built-in device slide-in technique (withdrawable)
Suitable for DIN rail (top hat rail) mounting		No


DIN rail (top hat rail) mounting optional	No
Number of auxiliary contacts as normally closed contact	0
Number of auxiliary contacts as normally open contact	0
Number of auxiliary contacts as change-over contact	0
With switched-off indicator	No
With under voltage release	No
Number of poles	4
Position of connection for main current circuit	Front side
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20

#### **Characteristics**

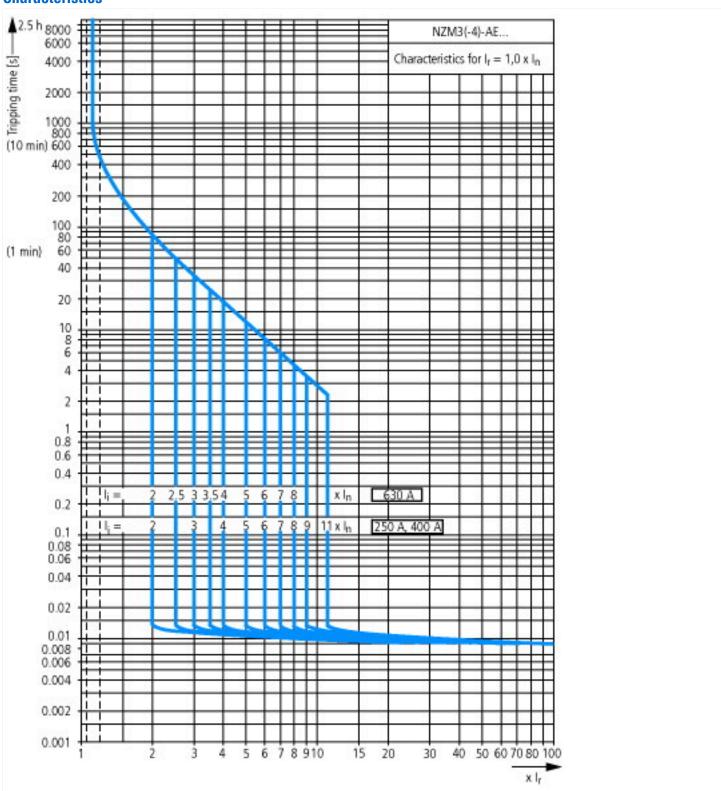


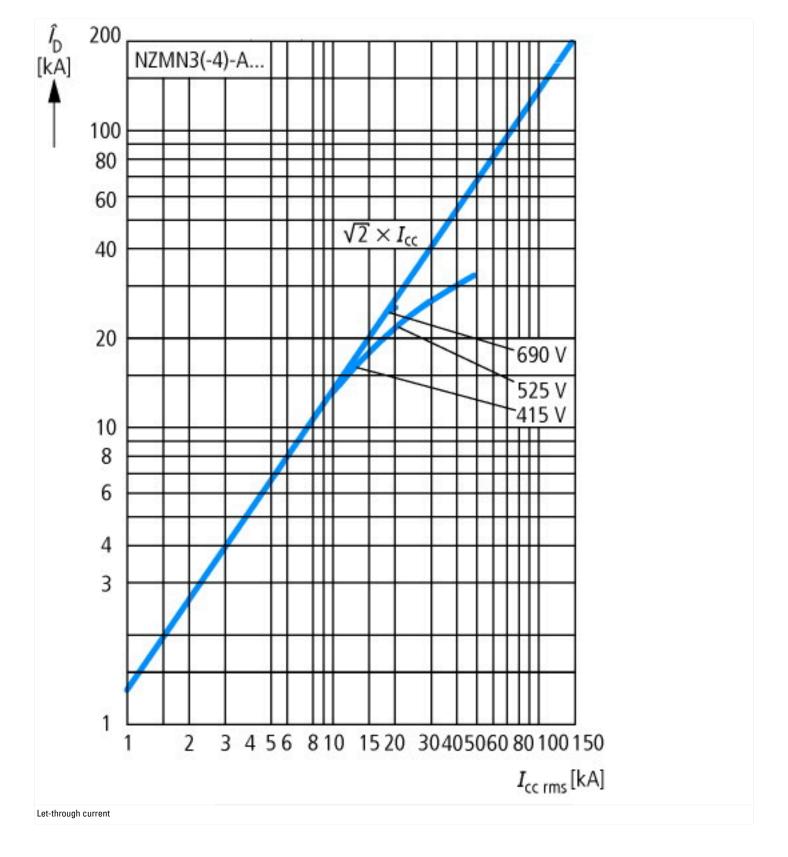


7 / 10

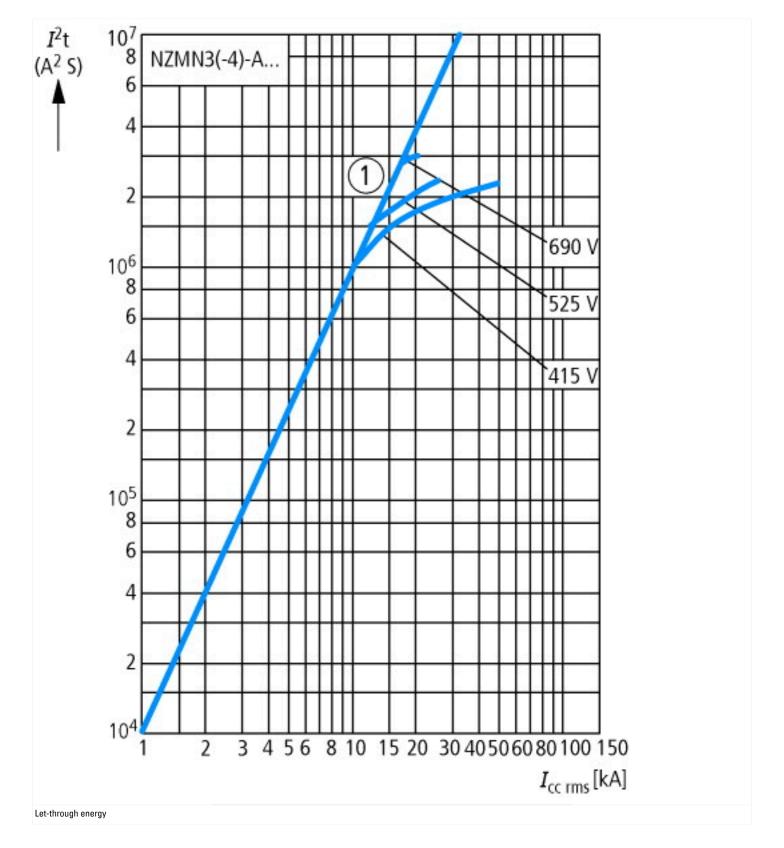

# **Dimensions**

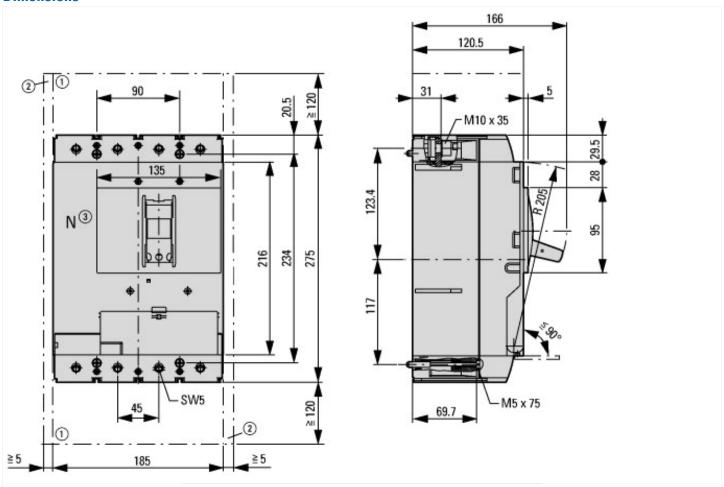

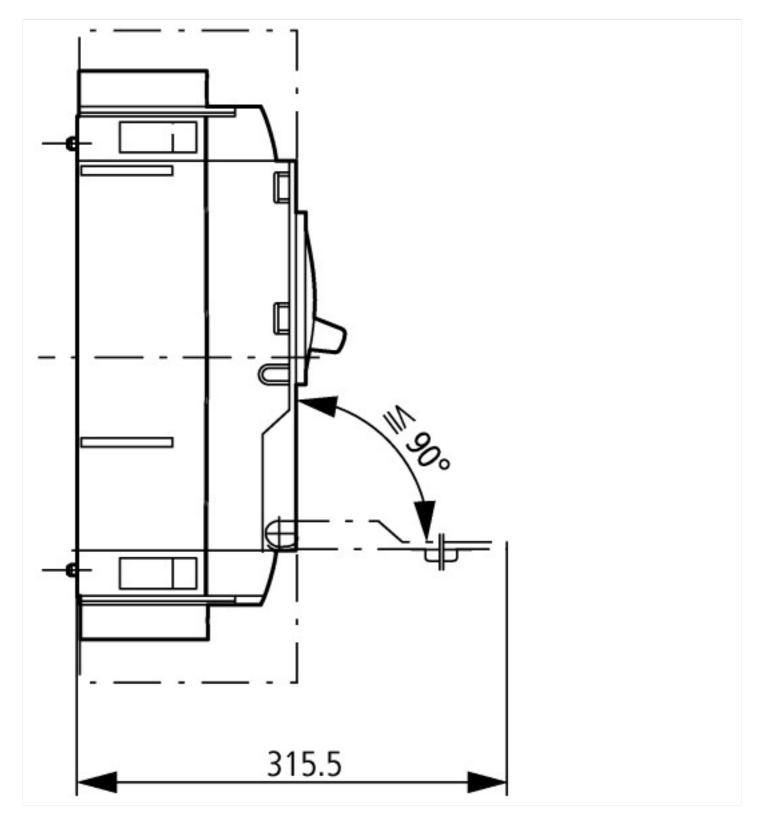

# **Additional product information (links)**

· · · · · · · · · · · · · · · · · · ·	
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf