# **DATASHEET - NZMS3-4-VX630**



# NZM3 PXR20 circuit breaker, 630A, 4p, screw terminal

Powering Business Worldwide

Part no. NZMS3-4-VX630 Catalog No. 191523

Similar to illustration

# **Delivery program**

| Delivery program                            |                        |    |   |
|---|------------------------|----|---|
| Product range                               |                        |    | Circuit-breaker   |
| Protective function                         |                        |    | Systems, cable, selectivity and generator protection  |
| Standard/Approval                           |                        |    | IEC   |
| Installation type                           |                        |    | Fixed   |
| Release system                              |                        |    | Electronic release  |
| Construction size                           |                        |    | NZM3  |
| Description                                 |                        |    | LSI overload protection and delayed and non-delayed short-circuit protective device R.m.s. value measurement and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Optionally communication-capable with interface module and internal Modbus RTU module or CAM |
| Number of poles                             |                        |    | 4 pole  |
| Standard equipment                          |                        |    | Screw connection  |
| Switching capacity                          |                        |    |   |
| 400/415 V 50 Hz                             | I <sub>cu</sub>        | kA | 70  |
| Rated current = rated uninterrupted current |                        |    |   |
| Rated current = rated uninterrupted current | $I_n = I_u$            | Α  | 630   |
| Neutral conductor                           | % of phase conductor   | %  | 100   |
| Setting range                               |                        |    |   |
| Overload trip                               |                        |    |   |
| 中   | I <sub>r</sub>         | A  | 252 - 630   |
| Short-circuit releases                      |                        |    |   |
| Non-delayed                                 | $I_i = I_n x \dots$    |    | 2-8   |
| Delayed X 1 >                               | $I_{sd} = I_r x \dots$ |    | 1.5 – 7   |

# **Technical data**

## General

| rds IEC/EN 60947  ion against direct contact Finger and back of han c proofing Damp heat, constant, t Damp heat, cyclic, to II  it temperature  bient temperature, storage °C - 40 - + 70 | nd proof to VDE 0106 Part 100 |
|---|-------------------------------|
| Damp heat, constant, t<br>Damp heat, cyclic, to II  | nd proof to VDE 0106 Part 100 |
| Damp heat, cyclic, to II  |                               |
| ·   |                               |
| bient temperature, storage °C - 40 - +70  |                               |
|   |                               |
| eration °C -25 - +70  |                               |
| nical shock resistance (10 ms half-sinusoidal shock) according to IEC g 20 (half-sinusoidal sho<br>1-27   | ck 20 ms)                     |
| olation to EN 61140   |                               |

| Between auxiliary contacts and main contacts          |                  | V AC | 500  |   |
|---|------------------|------|--|---|
| between the auxiliary contacts                        |                  | V AC | 300  |   |
| Mounting position                                     |                  |      | Vertical and 90° in all directions                               | With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions |
| Direction of incoming supply                          |                  |      | as required  |   |
| Degree of protection                                  |                  |      |  |   |
| Device  |                  |      | In the operating controls area: IP2                              | 0 (basic degree of protection)  |
| Enclosures  |                  |      | With insulating surround: IP40 With door coupling rotary handle: | IP66  |
| Terminations  |                  |      | Tunnel terminal: IP10 Phase isolator and strip terminal: I       | P00   |
| Other technical data (sheet catalogue)                |                  |      | Temperature dependency, Deratin                                  | g   |
| Circuit-breakers                                      |                  |      |  |   |
| Rated current = rated uninterrupted current           | $I_n = I_u$      | Α    | 630  |   |
| Rated surge voltage invariability                     | U <sub>imp</sub> |      |  |   |
| Main contacts   |                  | V    | 8000   |   |
| Auxiliary contacts                                    |                  | V    | 6000   |   |
| Rated operational voltage                             | U <sub>e</sub>   | V AC | 690  |   |
| Overvoltage category/pollution degree                 |                  |      | 111/3  |   |
| Rated insulation voltage                              | Ui               | V    | 690  |   |
| Jse in unearthed supply systems                       |                  | V    | ≦ 690  |   |
| Switching capacity                                    |                  |      |  |   |
| Rated short-circuit making capacity                   | I <sub>cm</sub>  |      |  |   |
| 240 V   | I <sub>cm</sub>  | kA   | 220  |   |
| 400/415 V   | I <sub>cm</sub>  | kA   | 154  |   |
| 440 V 50/60 Hz  | I <sub>cm</sub>  | kA   | 143  |   |
| 525 V 50/60 Hz  | I <sub>cm</sub>  | kA   | 80   |   |
| 690 V 50/60 H   | Ic               | kA   | 50   |   |
| Rated short-circuit breaking capacity I <sub>cn</sub> | I <sub>cn</sub>  |      |  |   |
| Icu to IEC/EN 60947 test cycle 0-t-C0                 | Icu              | kA   |  |   |
| 240 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 100  |   |
| 400/415 V 50/60 Hz                                    | I <sub>cu</sub>  | kA   | 70   |   |
| 440 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 65   |   |
| 525 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 36   |   |
| 690 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 25   |   |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0            | Ics              | kA   |  |   |
| 240 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 100  |   |
| 400/415 V 50/60 Hz                                    | I <sub>cs</sub>  | kA   | 70   |   |
| 440 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 65   |   |
| 525 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 18   |   |
| 690 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 6  |   |
|   | US               |      |  | ected short-circuit currents at the installation acity of the circuit-breaker.  |
| Rated short-time withstand current                    |                  |      |  |   |
| t = 0.3 s   | I <sub>cw</sub>  | kA   | 3.3  |   |
| t=1s  | I <sub>cw</sub>  | kA   | 3.3  |   |
| Jtilization category to IEC/EN 60947-2                |                  |      | A  |   |
|   |                  |      |  |   |

| Lifespan, electrical                                      |            |                 |   |
|---|------------|-----------------|---|
| AC-1  |            |                 |   |
| 400 V 50/60 Hz  | Operations |                 | 5000  |
| 415 V 50/60 Hz  | Operations |                 | 5000  |
| 690 V 50/60 Hz  | Operations |                 | 3000  |
| Max. operating frequency                                  | орогиноно  | Ops/h           | 60  |
| Total break time at short-circuit                         |            | ms              | < 10  |
| Terminal capacity   |            | IIIO            |   |
| Standard equipment  |            |                 | Screw connection  |
| Optional accessories                                      |            |                 | Box terminal Tunnel terminal connection on rear                                   |
| Round copper conductor                                    |            |                 |   |
| Box terminal  |            |                 |   |
| Solid   |            | mm <sup>2</sup> | 2 x 16  |
| Stranded  |            | mm <sup>2</sup> | 1 x (35 - 240)<br>2 x (25-120)  |
| Tunnel terminal   |            |                 |   |
| Solid   |            | mm <sup>2</sup> | 1 x 16  |
| Stranded  |            |                 |   |
| 1-hole  |            | $\mathrm{mm}^2$ | 1 x (16 - 185)  |
| Bolt terminal and rear-side connection                    |            |                 |   |
| Direct on the switch                                      |            |                 |   |
| Solid   |            | mm <sup>2</sup> | 1 x 16<br>2 x 16  |
| Stranded  |            | $\text{mm}^2$   | 1 x (25 - 240)<br>2 x (25 - 240)  |
| Connection width extension                                |            | mm <sup>2</sup> | 2 X (23 - 240)  |
| Connection width extension                                |            | $\text{mm}^2$   | 2 x 300   |
| Al circular conductor                                     |            |                 |   |
| Tunnel terminal   |            |                 |   |
| Solid   |            | mm <sup>2</sup> | 1 x 16  |
| Stranded  |            |                 |   |
| Stranded  |            | mm <sup>2</sup> | 1 x (25 - 185) <sup>2)</sup>  |
| Double hole   |            | mm <sup>2</sup> | 1 x (50 - 240)<br>2 x (50 - 240)  |
|   |            |                 | <sup>2)</sup> Up to 240 mm² can be connected depending on the cable manufacturer. |
| Cu strip (number of segments x width x segment thickness) |            |                 |   |
| Box terminal  |            |                 |   |
|   | min.       | mm              | 6 x 16 x 0.8  |
|   | max.       | mm              | 10 x 24 x 1.0<br>+ 5 x 24 x 1.0<br>(2 x) 8 x 24 x 1.0                             |
| Bolt terminal and rear-side connection                    |            |                 |   |
| Flat copper strip, with holes                             | min.       | mm              | 6 x 16 x 0.8  |
| Flat copper strip, with holes                             | max.       | mm              | 10 x 32 x 1.0 + 5 x 32 x 1.0  |
| Connection width extension                                |            | mm              | (2 x) 10 x 50 x 1.0   |
| Copper busbar (width x thickness)                         | mm         |                 |   |
| Bolt terminal and rear-side connection                    |            |                 |   |
| Screw connection  |            |                 | M10   |
| Direct on the switch                                      |            |                 |   |
|   | min.       | mm              | 20 x 5  |
|   | max.       | mm              | 30 x 10<br>+ 30 x 5   |
| Connection width extension                                |            | mm              | 2 (12 22)   |
| Connection width extension  Control cables                | max.       | mm              | 2 x (10 x 50)   |
|   |            | mm <sup>2</sup> | 1 x (0.75 - 2.5)  |

# Design verification as per IEC/EN 61439

| besign vermoundinas per illo/liv 01703  |                  |    |  |
|---|------------------|----|--|
| Technical data for design verification  |                  |    |  |
| Rated operational current for specified heat dissipation  | In               | Α  | 630  |
| Equipment heat dissipation, current-dependent   | P <sub>vid</sub> | W  | 119.07   |
| Operating ambient temperature min.  |                  | °C | -25  |
| Operating ambient temperature max.  |                  | °C | 70   |
| IEC/EN 61439 design verification  |                  |    |  |
| 10.2 Strength of materials and parts  |                  |    |  |
| 10.2.2 Corrosion resistance   |                  |    | Meets the product standard's requirements.   |
| 10.2.3.1 Verification of thermal stability of enclosures  |                  |    | Meets the product standard's requirements.   |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat  |                  |    | Meets the product standard's requirements.   |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects $$ |                  |    | Meets the product standard's requirements.   |
| 10.2.4 Resistance to ultra-violet (UV) radiation  |                  |    | Meets the product standard's requirements.   |
| 10.2.5 Lifting  |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.6 Mechanical impact  |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.7 Inscriptions   |                  |    | Meets the product standard's requirements.   |
| 10.3 Degree of protection of ASSEMBLIES   |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.4 Clearances and creepage distances  |                  |    | Meets the product standard's requirements.   |
| 10.5 Protection against electric shock  |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.6 Incorporation of switching devices and components  |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.7 Internal electrical circuits and connections   |                  |    | Is the panel builder's responsibility.   |
| 10.8 Connections for external conductors  |                  |    | Is the panel builder's responsibility.   |
| 10.9 Insulation properties  |                  |    |  |
| 10.9.2 Power-frequency electric strength  |                  |    | Is the panel builder's responsibility.   |
| 10.9.3 Impulse withstand voltage  |                  |    | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material  |                  |    | Is the panel builder's responsibility.   |
| 10.10 Temperature rise  |                  |    | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating  |                  |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility   |                  |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.13 Mechanical function   |                  |    | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |

## **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

| protection (ect@ss10.0.1-27-37-04-09 [AJZ/10013])         |    |  |
|---|----|--|
| Rated permanent current lu                                | А  | 630                                      |
| Rated voltage   | V  | 690 - 690                                |
| Rated short-circuit breaking capacity Icu at 400 V, 50 Hz | kA | 70                                       |
| Overload release current setting                          | Α  | 252 - 630                                |
| Adjustment range short-term delayed short-circuit release | А  | 1.5 - 7                                  |
| Adjustment range undelayed short-circuit release          | Α  | 2 - 8                                    |
| Integrated earth fault protection                         |    | No                                       |
| Type of electrical connection of main circuit             |    | Screw connection                         |
| Device construction                                       |    | Built-in device fixed built-in technique |
| Suitable for DIN rail (top hat rail) mounting             |    | No                                       |
| DIN rail (top hat rail) mounting optional                 |    | No                                       |
| Number of auxiliary contacts as normally closed contact   |    | 0  |
| Number of auxiliary contacts as normally open contact     |    | 0  |
| Number of auxiliary contacts as change-over contact       |    | 0  |
| With switched-off indicator                               |    | No                                       |
| With under voltage release                                |    | No                                       |


| Number of poles                                 | 4            |
|---|--------------|
| Position of connection for main current circuit | Front side   |
| Type of control element                         | Rocker lever |
| Complete device with protection unit            | Yes          |
| Motor drive integrated                          | No           |
| Motor drive optional                            | Yes          |
| Degree of protection (IP)                       | IP20         |


# **Characteristics**

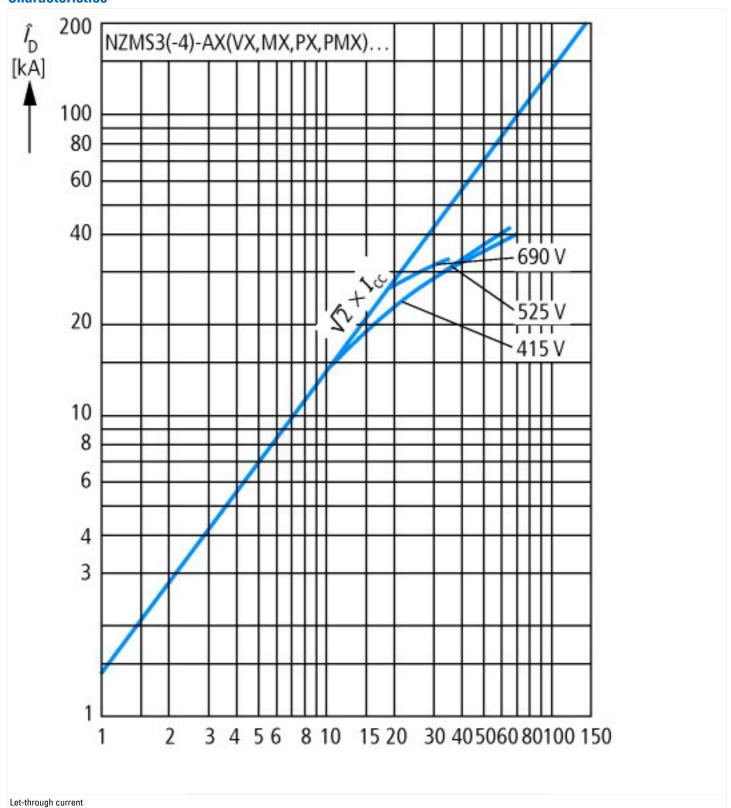

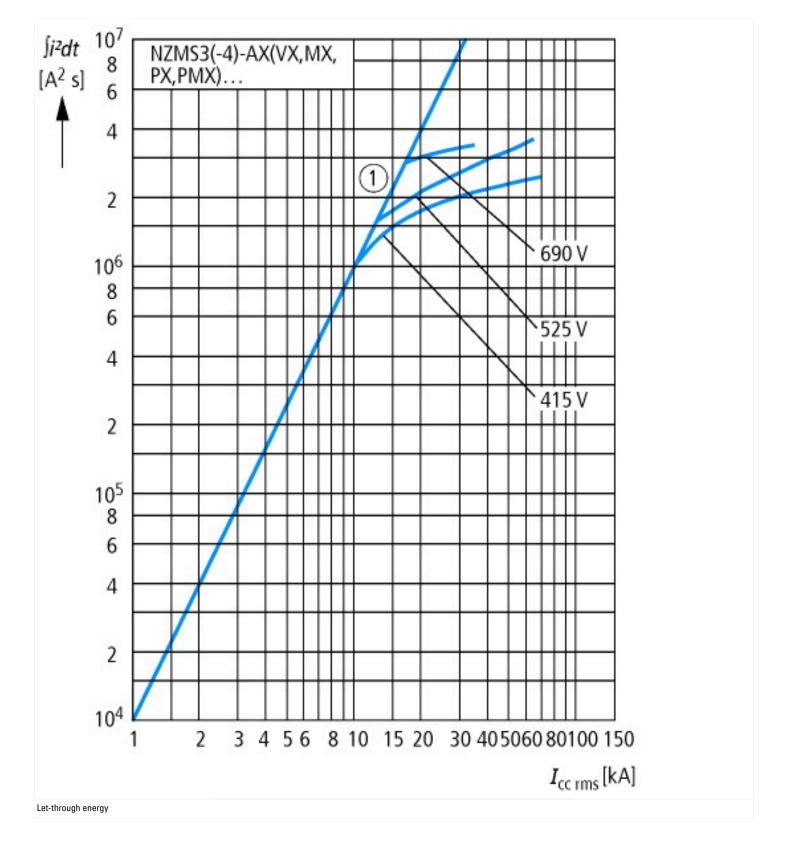

# **Dimensions**

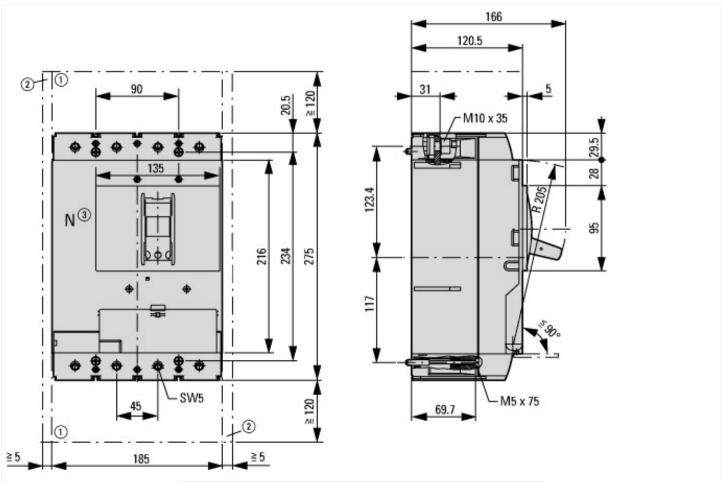

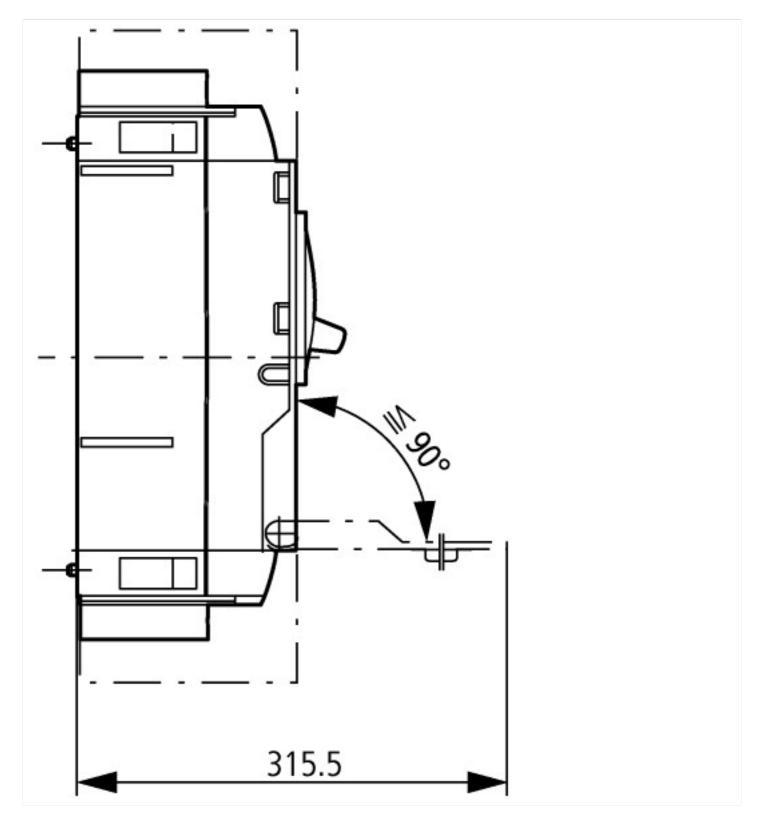

#### Additional product information (links)

| Additional product information (links)   |  |  |  |
|--|--|--|--|
| IL012100ZU NZM3-PXR circuit-breaker, basic device , NZM3-PXR Circuit-Breaker, basic unit |  |  |  |
| IL012100ZU NZM3-PXR circuit-breaker, basic device , NZM3-PXR Circuit-Breaker, basic unit | https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL012100ZU2020_10.pdf |  |  |
| Temperature dependency, Derating   | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172                 |  |  |
| additional technical information for NZM power switch                                    | https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf              |  |  |