DATASHEET - NZMB2-S125



Circuit-breaker, 3p, 125A

Part no. NZMB2-S125 Catalog No. 265736



Delivery program

| | | | Delivery program |
|--|----|---------------------|---|
| Circuit-breaker | | | Product range |
| Short-circuit protection | | | Protective function |
| IEC | | | Standard/Approval |
| Fixed | | | Installation type |
| Thermomagnetic release | | | Release system |
| NZM2 | | | Construction size |
| Motor protection in conjunction with overload relay With short-circuit release Without overload release Ir IEC/EN 60947-4-1, IEC/EN 60947-2 The circuit-breaker fulfills all requirements for AC-3 switching category. | | | Description |
| 3 pole | | | Number of poles |
| Screw connection | | | Standard equipment |
| 125 | Α | $I_n = I_u$ | Rated current = rated uninterrupted current |
| | | | Switching capacity |
| 25 | kA | I _{cu} | 400/415 V 50 Hz |
| | | | Setting range |
| | | | Short-circuit releases |
| 8 - 14 | | $I_i = I_n x \dots$ | Non-delayed |
| | | | Motor rating AC-3 at 400 V 50/60 Hz |
| 45 | kW | P | 380 V 400 V |
| | | | Rated operational current AC-3 at 400 V 50/60 Hz |
| 99 | Α | I _e | 400 V |
| | | | 380 V 400 V Rated operational current AC-3 at 400 V 50/60 Hz |

Technical data

General

| delicitat | | | |
|---|---|------|--|
| Standards | | | IEC/EN 60947 |
| Protection against direct contact | | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Ambient temperature, storage | • | °C | - 40 - + 70 |
| Operation | • | °C | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | 9 | g | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | | |
| Between auxiliary contacts and main contacts | , | V AC | 500 |
| between the auxiliary contacts | , | V AC | 300 |
| Weight | ı | kg | 2.345 |
| Mounting position | | | Vertical and 90° in all directions |

With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit
- NZM1, N1, NZM2, N2: vertical, 90° right/left

with withdrawable unit:
- NZM3, N3: vertical, 90° right/left

- NZM4, N4: vertical with remote operator:
- NZM2, N(S)2, NZM3, N(S)3,

NZM4, N(S)4: vertical and 90° in all

| | | | directions |
|---|------------------|---|---|
| Direction of incoming supply | | | as required |
| Degree of protection | | | |
| Device | | | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | | | With insulating surround: IP40 With door coupling rotary handle: IP66 |
| Terminations | | | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) | | | Temperature dependency, Derating |
| Circuit-breakers | | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 125 |
| Rated surge voltage invariability | U_{imp} | | |
| Main contacts | | V | 8000 |
| Auxiliary contacts | | V | 6000 |

V AC

٧

٧

Ui

440

111/3

690

≦ 440

Use in unearthed supply systems **Switching capacity**

Standard equipment

Optional accessories

Round copper conductor Box terminal Solid

Rated insulation voltage

Rated operational voltage

Overvoltage category/pollution degree

| orritoning supusity | | | |
|---|-----------------|-------|---|
| Rated short-circuit making capacity | I _{cm} | | |
| 240 V | I _{cm} | kA | 63 |
| 400/415 V | I _{cm} | kA | 53 |
| 440 V 50/60 Hz | I _{cm} | kA | 53 |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | | |
| Icu to IEC/EN 60947 test cycle 0-t-C0 | lcu | kA | |
| 240 V 50/60 Hz | I _{cu} | kA | 30 |
| 400/415 V 50/60 Hz | I _{cu} | kA | 25 |
| 440 V 50/60 Hz | Icu | kA | 25 |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | Ics | kA | |
| 240 V 50/60 Hz | I _{cs} | kA | 30 |
| 400/415 V 50/60 Hz | I _{cs} | kA | 25 |
| 440 V 50/60 Hz | I _{cs} | kA | 18.5 |
| | | | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Utilization category to IEC/EN 60947-2 | | | A |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | | 20000 |
| Lifespan, electrical | | | |
| AC-1 | | | |
| 400 V 50/60 Hz | Operations | | 10000 |
| 415 V 50/60 Hz | Operations | | 7500 |
| Max. operating frequency | | Ops/h | 120 |
| Total break time at short-circuit | | ms | < 10 |
| Terminal capacity | | | |

Screw connection

Box terminal Tunnel terminal connection on rear

1 x (10 - 16)

| | | | 2, (6, 16) |
|---|------|-----------------|--------------------------------------|
| Ctrondod | | 2 | 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 185) 2 x (25 - 70) |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| 1-hole | | mm^2 | 1 x (25 - 185) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 185) 2 x (25 - 70) |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Solid | | mm^2 | 1 x 16 |
| Stranded | | | |
| Stranded | | mm ² | 1 x (25 - 185) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (10 - 16) |
| Stranded | | mm ² | 1 x (25 - 50) 2 x (25 - 50) |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 2 x 9 x 0.8 |
| | max. | mm | 10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8 |
| Bolt terminal and rear-side connection | | | |
| Flat copper strip, with holes | min. | mm | 2 x 16 x 0.8 |
| Flat copper strip, with holes | max. | mm | 10 x 24 x 0.8 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M8 |
| Direct on the switch | | | |
| | min. | mm | 16 x 5 |
| | max. | mm | 24 x 8 |
| Control cables | | | |
| | | mm ² | 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) |

Design verification as per IEC/EN 61439

| In | Α | 125 |
|------------------|----|--|
| P _{vid} | W | 27.61 |
| | °C | -25 |
| | °C | 70 |
| | | |
| | | |
| | | Meets the product standard's requirements. |
| | | Meets the product standard's requirements. |
| | | Meets the product standard's requirements. |
| | | Meets the product standard's requirements. |
| | | Meets the product standard's requirements. |
| | | Does not apply, since the entire switchgear needs to be evaluated. |
| | | Does not apply, since the entire switchgear needs to be evaluated. |
| | | P _{vid} W °C |

| 10.2.7 Inscriptions | Meets the product standard's requirements. |
|--|--|
| 10.3 Degree of protection of ASSEMBLIES | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must b observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 7.0

Depth


Low-voltage industrial components (EG000017) / Motor protection circuit-breaker (EC000074)


| Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Motor protection circuit-breaker (ecl@ss10.0.1-27-37-04-01 [AGZ529016]) | | | | |
|---|----|--|--|--|
| Overload release current setting | Α | 0 - 0 | | |
| Adjustment range undelayed short-circuit release | Α | 8 - 14 | | |
| With thermal protection | | No | | |
| Phase failure sensitive | | No | | |
| Switch off technique | | Magnetic | | |
| Rated operating voltage | V | 440 - 440 | | |
| Rated permanent current lu | Α | 125 | | |
| Rated operation power at AC-3, 230 V | kW | 37 | | |
| Rated operation power at AC-3, 400 V | kW | 45 | | |
| Type of electrical connection of main circuit | | Screw connection | | |
| Type of control element | | Rocker lever | | |
| Device construction | | Built-in device fixed built-in technique | | |
| With integrated auxiliary switch | | No | | |
| With integrated under voltage release | | No | | |
| Number of poles | | 3 | | |
| Rated short-circuit breaking capacity Icu at 400 V, AC | kA | 25 | | |
| Degree of protection (IP) | | IP20 | | |
| Height | mm | 184 | | |
| Width | mm | 105 | | |


149


mm

Characteristics

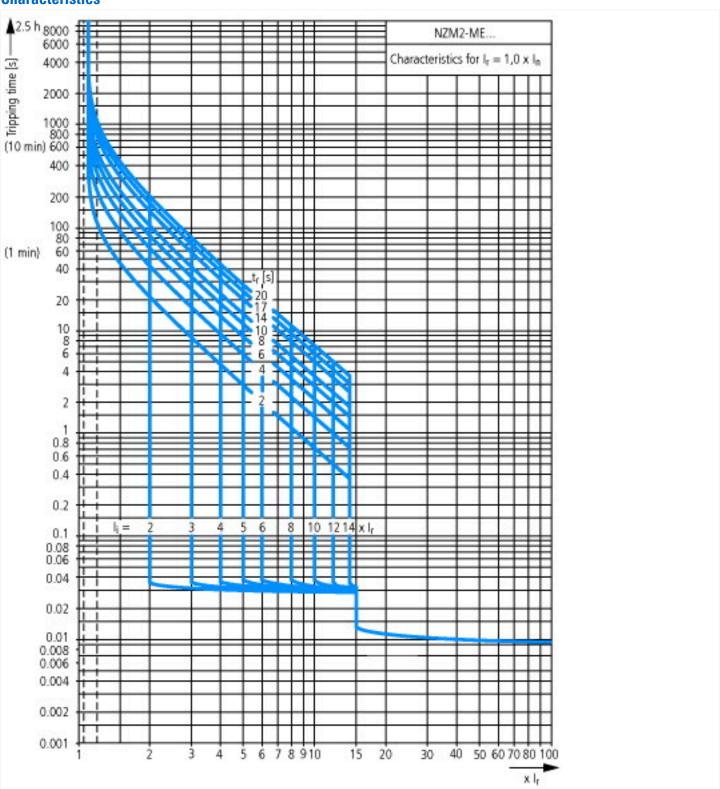


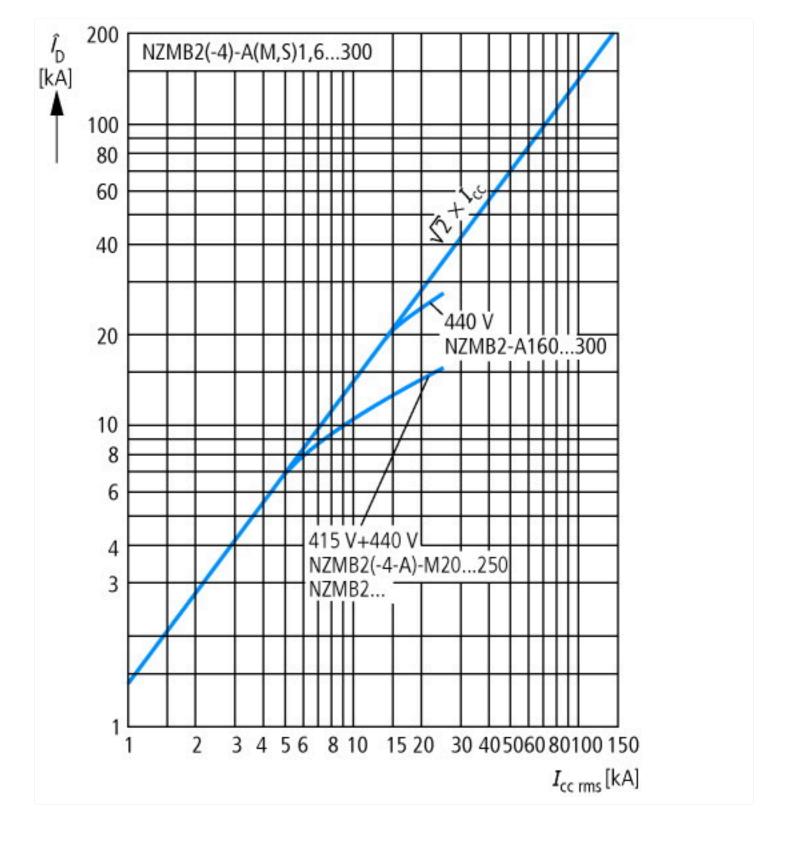

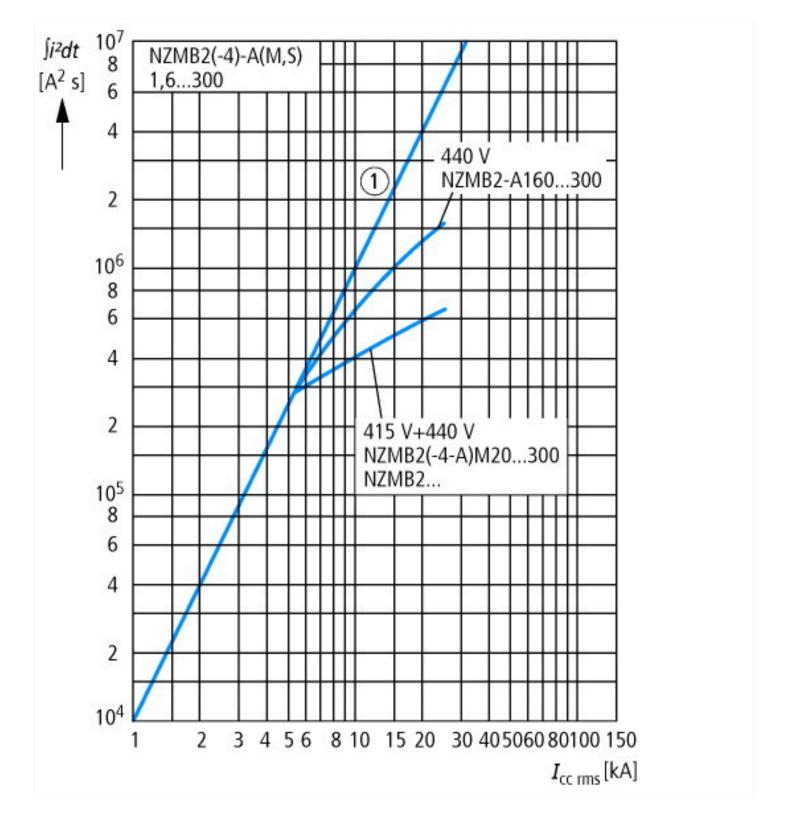


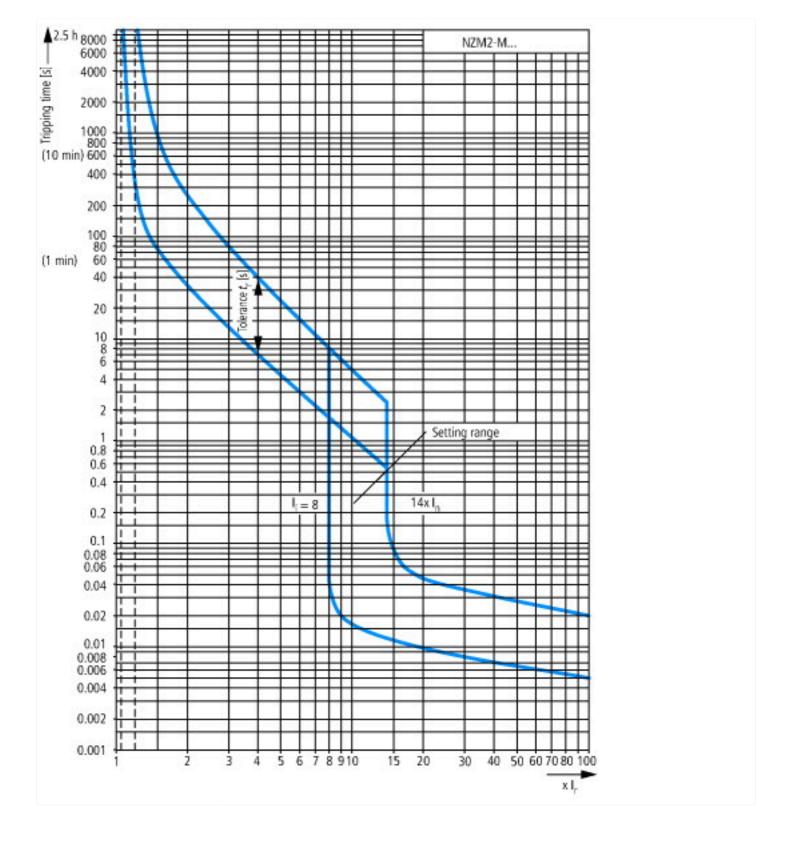

Dimensions

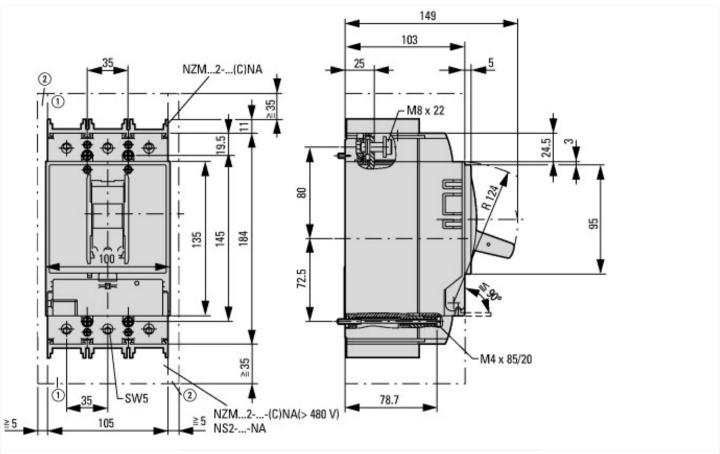

Blow out area, minimum clearance to adjacent parts
 Minimum clearance to adjacent parts

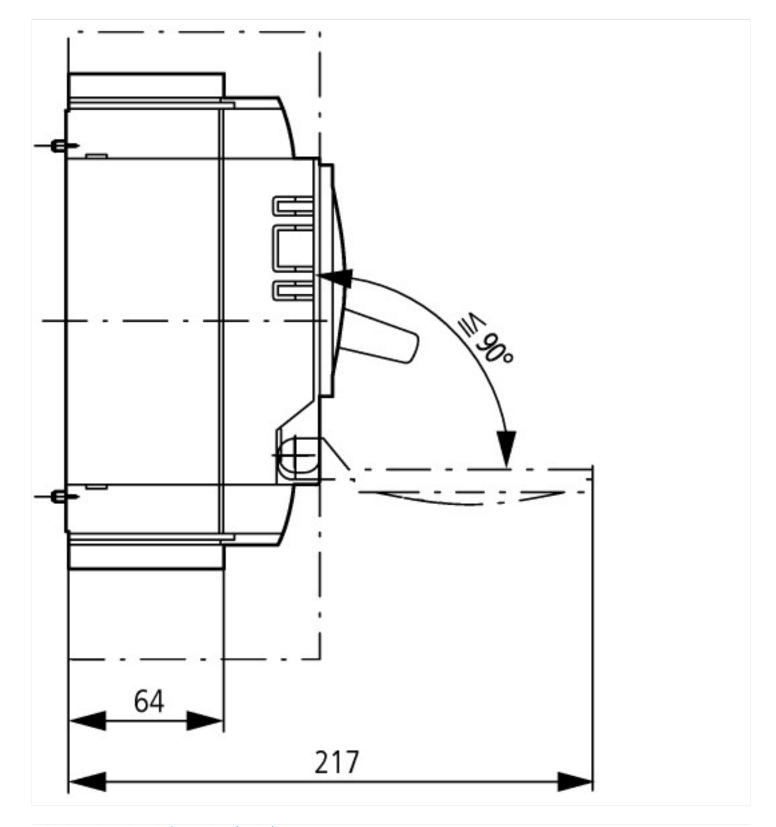

Additional product information (links)

| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 |
|---|--|
| CurveSelect characteristics program | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm |
| Eaton configurator | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/ConfiguratorCircuitBreaker/index.htm |
| additional technical information for NZM power switch | https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf |