DATASHEET - NZMC2-4-A160



Circuit-breaker, 4p, 160A

Part no. NZMC2-4-A160 Catalog No. 271432



Similar to illustration

| Delivery program | | | |
|---|-----------------------------------|-----|---|
| Product range | | | Circuit-breaker |
| Protective function | | | System and cable protection |
| Standard/Approval | | | IEC |
| Installation type | | | Fixed |
| Release system | | | Thermomagnetic release |
| Construction size | | | NZM2 |
| Description | | | Set value in neutral conductor is synchronous with set value Ir of main pole. |
| Number of poles | | | 4 pole |
| Standard equipment | | | Screw connection |
| Switching capacity | | | |
| 400/415 V 50 Hz | I _{cu} | kA | 36 |
| Rated current = rated uninterrupted current | | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | А | 160 |
| Neutral conductor | % of phase conductor | CSA | 100 |
| Setting range | | | |
| Overload trip | | | |
| द | I _r | A | 125 - 160 |
| Main pole | I _r | A | 125 - 160 |
| Short-circuit releases | | | |
| Non-delayed | I _i = I _n x | | 6 - 10 |
| Short-circuit releases | I _{rm} | A | 960 - 1600 |
| Technical data | | | |

| General | | |
|---|------|--|
| Standards | | IEC/EN 60947 |
| Protection against direct contact | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | |
| Ambient temperature, storage | °C | - 40 - + 70 |
| Operation | °C | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | |
| Between auxiliary contacts and main contacts | V AC | 500 |
| between the auxiliary contacts | V AC | 300 |

| Mounting position | | | Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions |
|--|------------------------------------|----------|---|
| Direction of incoming supply | | | as required |
| Degree of protection | | | |
| Device | | | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | | | With insulating surround: IP40 With door coupling rotary handle: IP66 |
| Terminations | | | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) Circuit-breakers | | | Temperature dependency, Derating |
| CITCUIT-DREAKERS Rated current = rated uninterrupted current | I _n = I _u | А | 160 |
| Rated surge voltage invariability | U _{imp} | | |
| | O _{IMp} | V | 2000 |
| Main contacts | | v | 8000 6000 |
| Auxiliary contacts Rated operational voltage | U _e | V AC | 690 |
| | 0 _e | V AU | 111/3 |
| Overvoltage category/pollution degree Rated insulation voltage | Ui | V | 690 |
| Use in unearthed supply systems | 01 | v | ≦ 690 |
| Switching capacity | | v | = 050 |
| Rated short-circuit making capacity | I _{cm} | | |
| 240 V | I _{cm} | kA | 121 |
| 400/415 V | I _{cm} | kA | 76 |
| 440 V 50/60 Hz | I _{cm} | kA | 63 |
| 525 V 50/60 Hz | I _{cm} | kA | 24 |
| 690 V 50/60 H | lc | kA | 14 |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | | |
| Icu to IEC/EN 60947 test cycle 0-t-C0 | lcu | kA | |
| 240 V 50/60 Hz | I _{cu} | kA | 55 |
| 400/415 V 50/60 Hz | I _{cu} | kA | 36 |
| 440 V 50/60 Hz | I _{cu} | kA | 30 |
| 525 V 50/60 Hz | | kA | 12 |
| 690 V 50/60 Hz | I _{cu} I _{cu} | kA kA | 8 |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | | kA | |
| 240 V 50/60 Hz | lcs | кА kA | 55 |
| | I _{cs} | | |
| 400/415 V 50/60 Hz | I _{cs} | kA kA | 36 |
| 440 V 50/60 Hz | I _{cs} | kA | 22.5 |
| 525 V 50/60 Hz | I _{cs} | kA | 6 |
| 690 V 50/60 Hz Utilization category to IEC/EN 60947-2 | I _{cs} | kA | 4 Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. A |
| Lifespan, mechanical(of which max. 50 $\%$ trip by shunt/undervoltage release) | Operations | | 20000 |
| Lifespan, electrical | | | |
| AC-1 | | | |
| 400 V 50/60 Hz | Operations | | 10000 |
| 415 V 50/60 Hz | Operations | | 7500 |
| 690 V 50/60 Hz | Operations | | 5000 |

| Max. operating frequency | | Ops/h | 120 |
|---|------|-----------------|---|
| Total break time at short-circuit | | ms | < 10 |
| Terminal capacity | | 1110 | |
| Standard equipment | | | Screw connection |
| Optional accessories | | | Box terminal Tunnel terminal connection on rear |
| Round copper conductor | | | |
| Box terminal | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 185) 2 x (25 - 70) |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| 1-hole | | mm ² | 1 x (25 - 185) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 185) 2 x (25 - 70) |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| Stranded | | mm ² | 1 x (25 - 185) |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 2 x 9 x 0.8 |
| | max. | mm | 10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8 |
| Bolt terminal and rear-side connection | | | |
| Flat copper strip, with holes | min. | mm | 2 x 16 x 0.8 |
| Flat copper strip, with holes | max. | mm | 10 x 24 x 0.8 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M8 |
| Direct on the switch | | | |
| | min. | mm | 16 x 5 |
| | max. | mm | 24 x 8 |
| Control cables | | | |
| | | mm ² | 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) 2 x (0.75 - 1.5) |

Design verification as per IEC/EN 61439

| Technical data for design verification | | | |
|--|------------------|----|--|
| Rated operational current for specified heat dissipation | In | Α | 160 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 38.4 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |

| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | Meets the product standard's requirements. |
|--|--|
| 10.2.4 Resistance to ultra-violet (UV) radiation | Meets the product standard's requirements. |
| 10.2.5 Lifting | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


| Rated permanent current lu | А | 160 |
|---|----|--|
| Rated voltage | V | 690 - 690 |
| Rated short-circuit breaking capacity Icu at 400 V, 50 Hz | kA | 36 |
| Overload release current setting | А | 125 - 160 |
| Adjustment range short-term delayed short-circuit release | А | 0 - 0 |
| Adjustment range undelayed short-circuit release | А | 960 - 1600 |
| Integrated earth fault protection | | No |
| Type of electrical connection of main circuit | | Screw connection |
| Device construction | | Built-in device fixed built-in technique |
| Suitable for DIN rail (top hat rail) mounting | | No |
| DIN rail (top hat rail) mounting optional | | Yes |
| Number of auxiliary contacts as normally closed contact | | 0 |
| Number of auxiliary contacts as normally open contact | | 0 |
| Number of auxiliary contacts as change-over contact | | 0 |
| With switched-off indicator | | No |
| With under voltage release | | No |
| Number of poles | | 4 |
| Position of connection for main current circuit | | Front side |
| Type of control element | | Rocker lever |
| Complete device with protection unit | | Yes |
| Motor drive integrated | | No |
| Motor drive optional | | Yes |
| Degree of protection (IP) | | IP20 |
| | | |




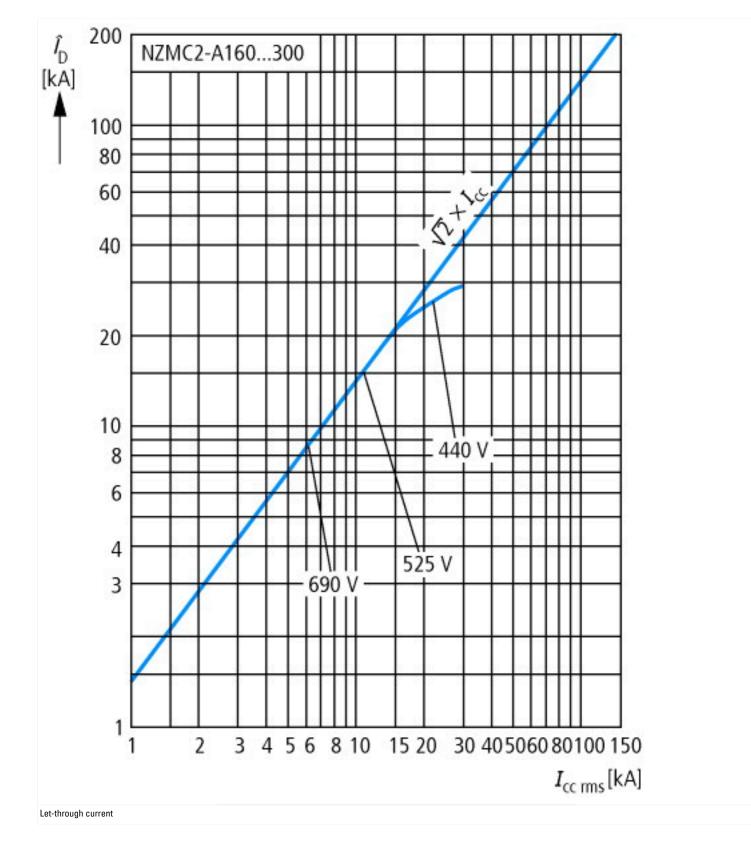

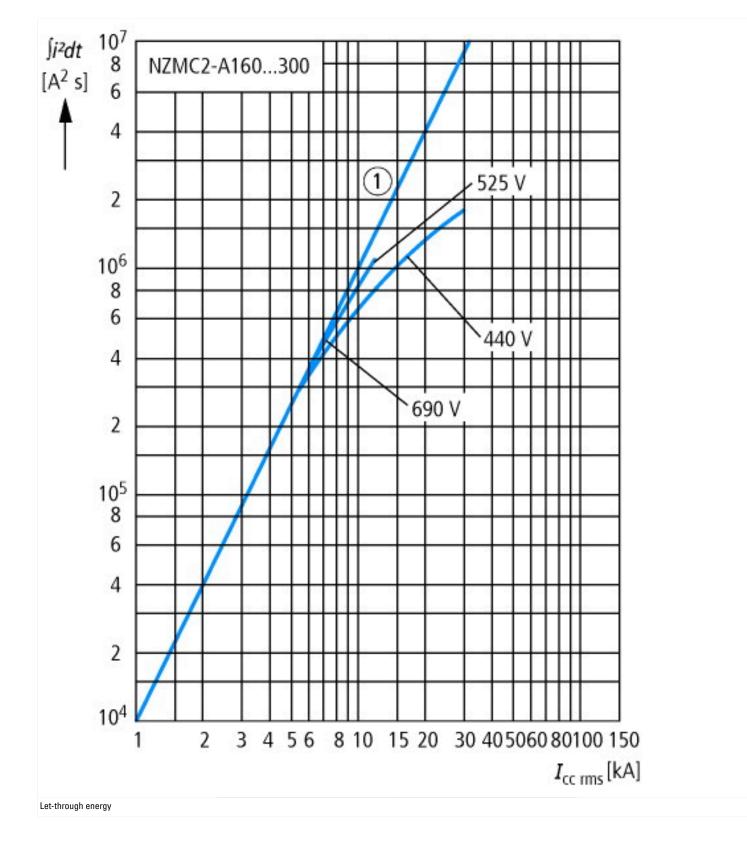



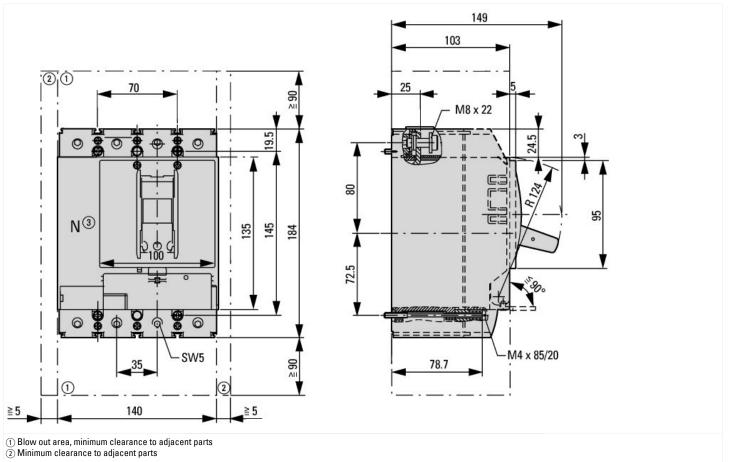

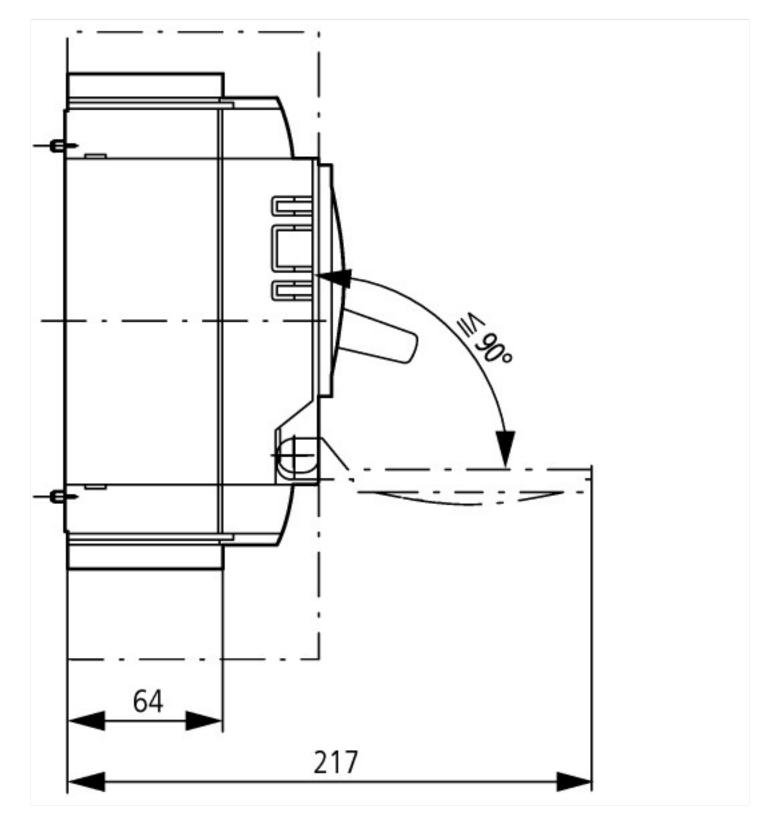

Additional product information (links)

| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 |
|---|--|
| CurveSelect characteristics program | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/ index.htm |
| additional technical information for NZM power switch | https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf |