DATASHEET - NZMB1-4-A20



Circuit-breaker, 4p, 20A

Part no. NZMB1-4-A20 Catalog No. 281237

EL-Nummer (Norway)

0004358983

Similar to illustration



Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
Installation type			Fixed
Release system			Thermomagnetic release
Construction size			NZM1
Description			Set value in neutral conductor is synchronous with set value Ir of main pole.
Number of poles			4 pole
Standard equipment			Box terminal
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	25
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	20
Neutral conductor	% of phase conductor	%	100
Setting range			
Overload trip			
中	I _r	Α	15 - 20
Main pole	I _r	A	15 - 20
Short-circuit releases			
Non-delayed	$I_i = I_n \times \dots$		350 A fixed

Technical data

1>

min.

Short-circuit releases

General

20110101		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		

350

Between auxiliary contacts and main contacts		V AC	500	
between the auxiliary contacts		V AC	300	
<u> </u>		· Au		
Mounting position			Vertical and 90° in all directions	With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required	
Degree of protection			as required	
Device			In the operating controls area: IP2	20 (hasis degree of protection)
Enclosures			With insulating surround: IP40	to (basic degree or protection)
2.10.000.00			With door coupling rotary handle:	IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal:	IP00
Other technical data (sheet catalogue)			Temperature dependency, Deratir	ng
Circuit-breakers				
Rated current = rated uninterrupted current	$I_n = I_u$	Α	20	
Rated surge voltage invariability	U _{imp}			
Main contacts		V	6000	
Auxiliary contacts		٧	6000	
Rated operational voltage	U _e	V AC	440	
Overvoltage category/pollution degree			III/3	
Rated insulation voltage	Ui	V	690	
Use in unearthed supply systems		V	≦ 440	
Switching capacity				
Rated short-circuit making capacity	I _{cm}			
240 V	I _{cm}	kA	63	
400/415 V	I _{cm}	kA	53	
440 V 50/60 Hz	I _{cm}	kA	53	
Rated short-circuit breaking capacity I _{cn}	I _{cn}			
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA		
240 V 50/60 Hz		kA	30	
	I _{cu}			
400/415 V 50/60 Hz	I _{cu}	kA	25	
440 V 50/60 Hz	I _{cu}	kA	25	
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA		
240 V 50/60 Hz	I _{cs}	kA	30	
400/415 V 50/60 Hz	I _{cs}	kA	25	
440 V 50/60 Hz	I _{cs}	kA	18.5	
			Maximum back-up fuse, if the exp location exceed the switching cap	ected short-circuit currents at the installation pacity of the circuit-breaker.
Utilization category to IEC/EN 60947-2			A	
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000	
Lifespan, electrical				
AC-1				
400 V 50/60 Hz	Operations		7500	
415 V 50/60 Hz	Operations		7500	
		Ops/h	120	
Max. operating frequency				
Max. operating frequency Total break time at short-circuit		ms	< 10	
		ms	< 10	
Total break time at short-circuit		ms	< 10 Box terminal	

Round copper conductor			
Box terminal			
Solid		mm ²	1 x (6 - 16) 2 x (4 - 16)
Stranded		mm ²	1 x (6 - 70) ³⁾ 2 x (4 - 25)
			³⁾ Up to 95 mm² can be connected depending on the cable manufacturer.
Tunnel terminal			
Solid		mm^2	1 x 16
Stranded			
1-hole		mm ²	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (6 - 16) 2 x (4 - 16)
Stranded		mm ²	1 x (6 - 70) ³⁾ 2 x (4 - 25)
			³⁾ Up to 95 mm ² can be connected depending on the cable manufacturer.
Al circular conductor			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm ²	1 x (25 - 35) 2 x (25 - 35)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	9 x 9 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M6
Direct on the switch			
	min.	mm	12 x 5
	max.	mm	16 x 5
Control cables		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Rated operational current for specified heat dissipation In A 20 Equipment heat dissipation, current-dependent Pvid W 9.82 Operating ambient temperature min. °C -25 Operating ambient temperature max. °C 70				
Equipment heat dissipation, current-dependent Pvid W 9.82 Operating ambient temperature min. Operating ambient temperature max. °C 70 IEC/EN 61439 design verification 10.2 Strength of materials and parts 10.2.2 Corrosion resistance 10.2.3.1 Verification of thermal stability of enclosures 10.2.3.2 Verification of resistance of insulating materials to normal heat and fire due to internal electric effects Pvid W 9.82 70 Reets the product standard's requirements. Meets the product standard's requirements.	Technical data for design verification			
Operating ambient temperature min. Operating ambient temperature max. Operating ambient temperature min. Operating ambient temperature max. Operating ambient temperature max. Indicator operature max. Operating ambient temperature max. Indicator operature max. Indicator operat	Rated operational current for specified heat dissipation	In	Α	20
Operating ambient temperature max. 10.2 Strength of materials and parts 10.2.2 Corrosion resistance 10.2.3.1 Verification of thermal stability of enclosures 10.2.3.2 Verification of resistance of insulating materials to normal heat and fire due to internal electric effects 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects 10.2.3.4 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects 10.2.3.5 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Equipment heat dissipation, current-dependent	P _{vid}	W	9.82
IEC/EN 61439 design verification 10.2 Strength of materials and parts 10.2.2 Corrosion resistance Meets the product standard's requirements. 10.2.3.1 Verification of thermal stability of enclosures Meets the product standard's requirements.	Operating ambient temperature min.		°C	-25
10.2 Strength of materials and parts 10.2.2 Corrosion resistance Meets the product standard's requirements. 10.2.3.1 Verification of thermal stability of enclosures Meets the product standard's requirements.	Operating ambient temperature max.		°C	70
10.2.2 Corrosion resistance Meets the product standard's requirements.	IEC/EN 61439 design verification			
10.2.3.1 Verification of thermal stability of enclosures Meets the product standard's requirements.	10.2 Strength of materials and parts			
10.2.3.2 Verification of resistance of insulating materials to normal heat 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects Meets the product standard's requirements.	10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects Meets the product standard's requirements.	10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
and fire due to internal electric effects	10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements.	· · · · · · · · · · · · · · · · · · ·			Meets the product standard's requirements.
	10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.

10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

protection (eci@3310.0.1-27-07-04-03 [A02710010])		
Rated permanent current lu	А	20
Rated voltage	V	440 - 440
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	25
Overload release current setting	А	15 - 20
Adjustment range short-term delayed short-circuit release	А	0 - 0
Adjustment range undelayed short-circuit release	А	350 - 350
Integrated earth fault protection		No
Type of electrical connection of main circuit		Frame clamp
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No
With under voltage release		No
Number of poles		4
Position of connection for main current circuit		Front side
Type of control element		Rocker lever
Complete device with protection unit		Yes
Motor drive integrated		No
Motor drive optional		No
Degree of protection (IP)		IP20


Characteristics

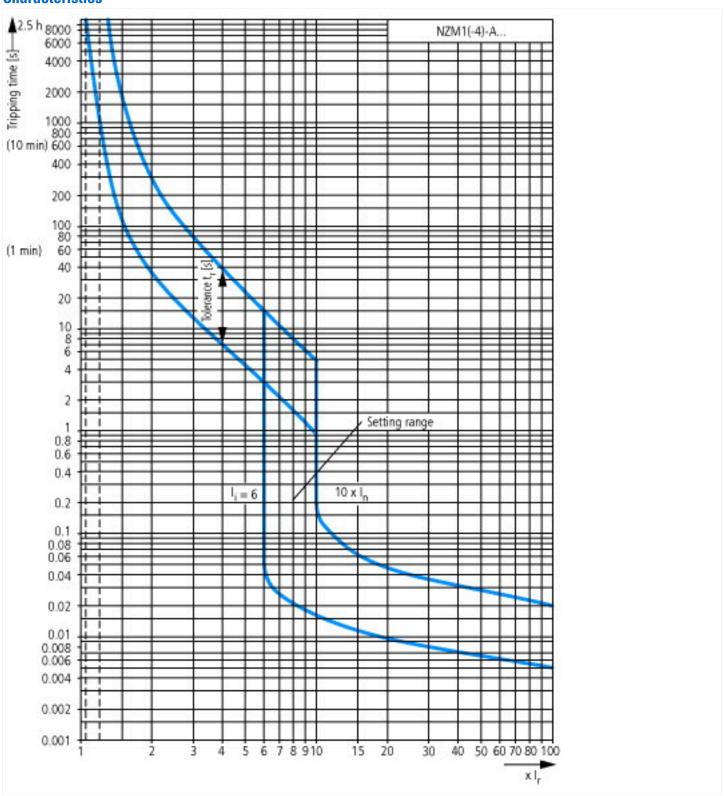


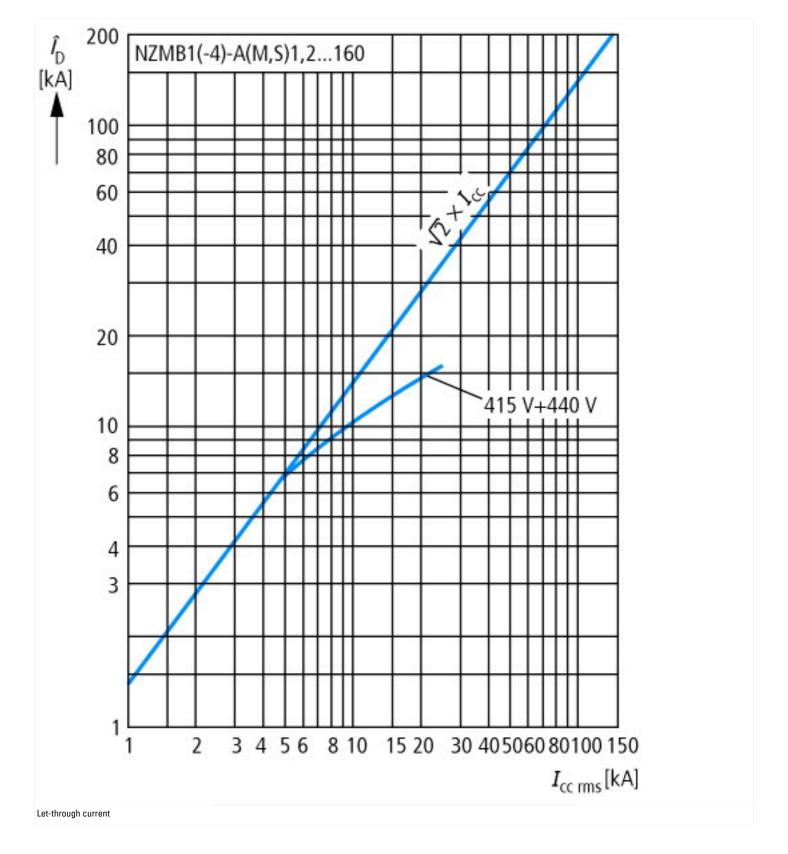

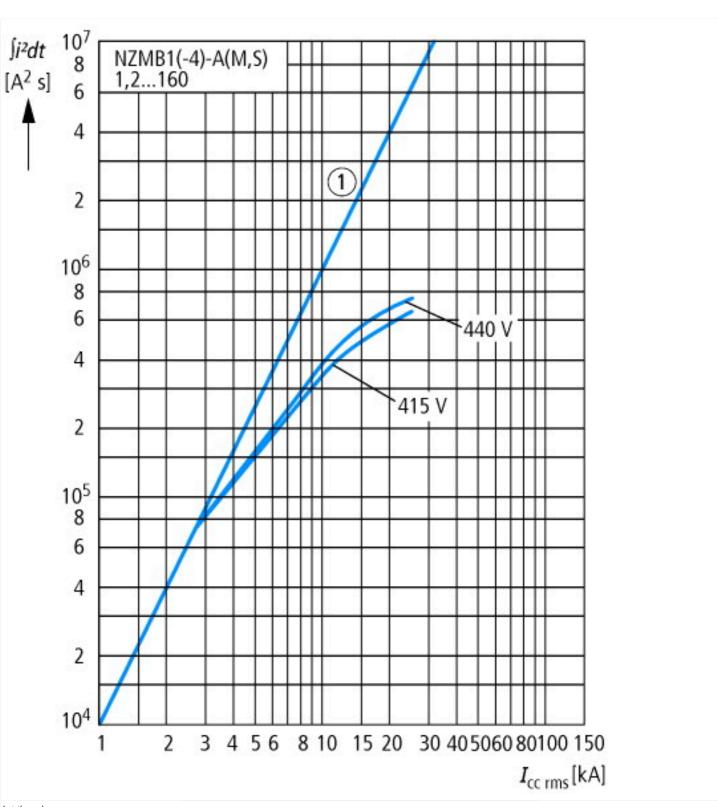

Dimensions

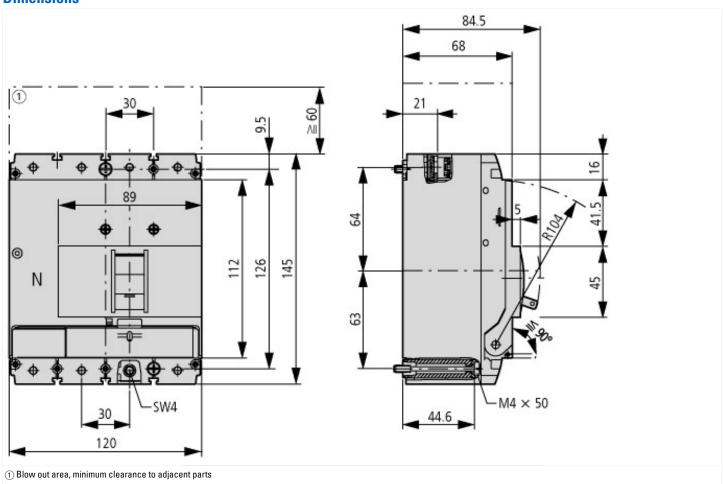

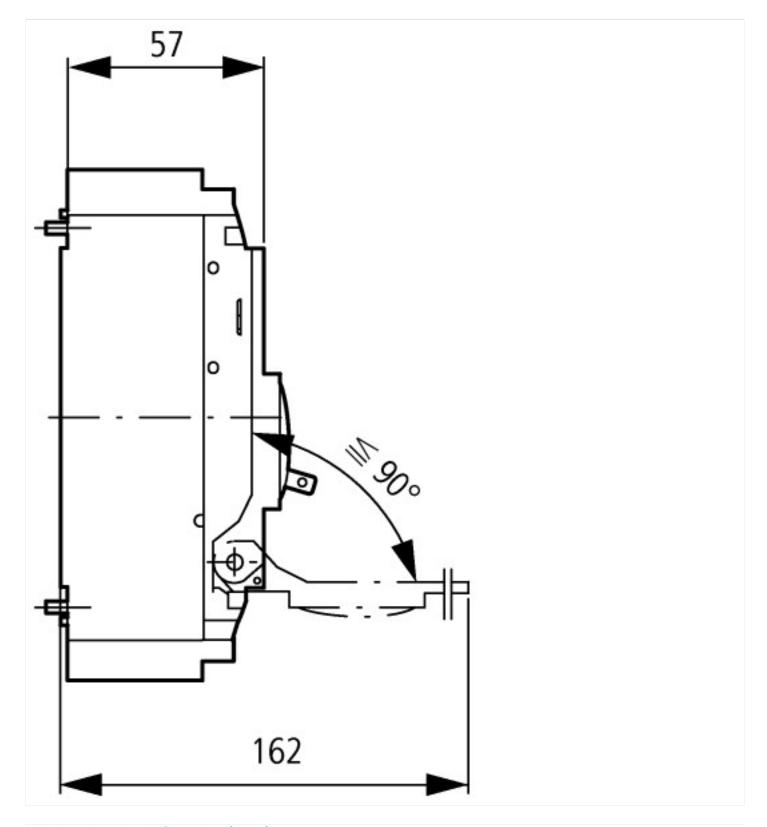

Additional product information (links)

IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector		
IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf	
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172	
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm	
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf	