DATASHEET - NZMN1-4-A20



Circuit-breaker, 4p, 20A

Part no.

Catalog No.

EL-Nummer

(Norway)

NZMN1-4-A20 281245

0004358987



Similar to illustration

Delivery program Product range Circuit-breaker Protective function System and cable protection IEC Standard/Approval Fixed Installation type Release system Thermomagnetic release Construction size NZM1 Description Set value in neutral conductor is synchronous with set value Ir of main pole. Number of poles 4 pole Standard equipment Box terminal Switching capacity 400/415 V 50 Hz kA 50 I_{cu} Rated current = rated uninterrupted current Rated current = rated uninterrupted current А 20 $I_n = I_u$ Neutral conductor % of phase CSA 100 conductor **Setting range** Overload trip 15 - 20 ١_r А Main pole ١_r А 15 - 20 Short-circuit releases 1> Non-delayed $I_i = I_n x \dots$ 350 A fixed 1> Short-circuit releases 1> min. А 350

Technical data

| General | | |
|---|----|--|
| Standards | | IEC/EN 60947 |
| Protection against direct contact | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | |
| Ambient temperature, storage | °C | - 40 - + 70 |
| Operation | °C | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | |

| Between auxiliary contacts and main contacts | | V AC | 500 | |
|---|---------------------------------|----------|---|---|
| between the auxiliary contacts | | V AC | 300 | |
| Mounting position | | | Vertical and 90° in all directions | With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions |
| Direction of incoming supply | | | as required | |
| Degree of protection | | | | |
| Device | | | In the operating controls area: IP20 | 0 (basic degree of protection) |
| Enclosures | | | With insulating surround: IP40 With door coupling rotary handle: I | IP66 |
| Terminations | | | Tunnel terminal: IP10 Phase isolator and strip terminal: I | P00 |
| Other technical data (sheet catalogue) | | | Temperature dependency, Derating | g |
| Circuit-breakers | | ٨ | 20 | |
| Rated current = rated uninterrupted current | I _n = I _u | A | 20 | |
| Rated surge voltage invariability | U _{imp} | | 2000 | |
| Main contacts | | V | 6000 | |
| Auxiliary contacts | | V | 6000 | |
| Rated operational voltage | U _e | V AC | 690 III./2 | |
| Overvoltage category/pollution degree | 11. | V | lll/3 690 | |
| Rated insulation voltage | Ui | | | |
| Use in unearthed supply systems Switching capacity | | V | ≦ 690 | |
| Rated short-circuit making capacity | I _{cm} | | | |
| 240 V | I _{cm} | kA | 187 | |
| 400/415 V | I _{cm} | kA | 105 | |
| 440 V 50/60 Hz | I _{cm} | kA | 74 | |
| 525 V 50/60 Hz | I _{cm} | kA | 40 | |
| 690 V 50/60 H | lc | kA | 17 | |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | | | |
| Icu to IEC/EN 60947 test cycle O-t-CO | lcu | kA | | |
| 240 V 50/60 Hz | I _{cu} | kA | 85 | |
| 400/415 V 50/60 Hz | I _{cu} | kA | 50 | |
| 440 V 50/60 Hz | I _{cu} | kA | 35 | |
| 525 V 50/60 Hz | I _{cu} | kA | 20 | |
| 690 V 50/60 Hz | I _{cu} | kA | 10 | |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | lcs | kA | | |
| 240 V 50/60 Hz | I _{cs} | kA | 85 | |
| 400/415 V 50/60 Hz | I _{cs} | kA | 50 | |
| 440 V 50/60 Hz | | kA | 35 | |
| 525 V 50/60 Hz | I _{cs} | кА kA | 10 | |
| | I _{cs} | | | |
| 690 V 50/60 Hz | I _{cs} | kA | 7.5 Maximum back-up fuse, if the expe location exceed the switching cap | ected short-circuit currents at the installation acity of the circuit-breaker. |
| Utilization category to IEC/EN 60947-2 | | | А | |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | | 20000 | |
| Lifespan, electrical | | | | |
| AC-1 | | | | |
| 400 V 50/60 Hz | Operations | | 10000 | |

| 415 V 50/60 Hz | Operations | | 10000 |
|---|------------|-----------------|--|
| 690 V 50/60 Hz | Operations | | 7500 |
| Max. operating frequency | operations | Ops/h | 120 |
| Total break time at short-circuit | | ms | < 10 |
| Terminal capacity | | 1115 | |
| Standard equipment | | | Box terminal |
| Optional accessories | | | Screw connection Tunnel terminal connection on rear |
| Round copper conductor | | | |
| Box terminal | | | |
| Solid | | mm ² | 1 x (6 - 16) 2 x (4 - 16) |
| Stranded | | mm ² | 1 x (6 - 70) ³⁾ 2 x (4 - 25) |
| | | | $^{3)}$ Up to 95 $\rm mm^2$ can be connected depending on the cable manufacturer. |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| 1-hole | | mm ² | 1 x (25 - 95) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (6 - 16) 2 x (4 - 16) |
| Stranded | | mm ² | 1 x (6 - 70) ³⁾ 2 x (4 - 25) |
| | | | ³⁾ Up to 95 mm ² can be connected depending on the cable manufacturer. |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| Stranded | | mm ² | 1 x (25 - 95) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (10 - 16) |
| Stranded | | mm ² | 1 x (25 - 35) 2 x (25 - 35) |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 2 x 9 x 0.8 |
| | max. | mm | 9 x 9 x 0.8 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M6 |
| Direct on the switch | | | |
| | min. | mm | 12 x 5 |
| | max. | mm | 16 x 5 |
| Control cables | | | |


Design verification as per IEC/EN 61439


| Technical data for design verification | | | |
|--|------------------|----|------|
| Rated operational current for specified heat dissipation | I _n | А | 20 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 9.82 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |


| C/EN 61439 design verification | |
|--|--|
| 10.2 Strength of materials and parts | |
| 10.2.2 Corrosion resistance | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | Meets the product standard's requirements. |
| 10.2.5 Lifting | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must bobserved. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must bobserved. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 7.0


| Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/ | generator/installatio | on prote | action (EC000228) |
|---|------------------------|----------|---|
| Electric engineering, automation, process control engineering / Low-voltage sw protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013]) | itch technology / Circ | cuit bre | taker (LV < 1 kV) / Circuit breaker for power transformer, generator and system |
| Rated permanent current lu | А | ۱. | 20 |
| Rated voltage | v | 1 | 690 - 690 |
| Rated short-circuit breaking capacity lcu at 400 V, 50 Hz | k <i>A</i> | A | 50 |
| Overload release current setting | А | • | 15 - 20 |
| Adjustment range short-term delayed short-circuit release | А | 1 | 0 - 0 |
| Adjustment range undelayed short-circuit release | A | 1 | 350 - 350 |
| Integrated earth fault protection | | | No |
| Type of electrical connection of main circuit | | | Frame clamp |
| Device construction | | | Built-in device fixed built-in technique |
| Suitable for DIN rail (top hat rail) mounting | | | No |
| DIN rail (top hat rail) mounting optional | | | Yes |
| Number of auxiliary contacts as normally closed contact | | | 0 |
| Number of auxiliary contacts as normally open contact | | | 0 |
| Number of auxiliary contacts as change-over contact | | | 0 |
| Nith switched-off indicator | | | No |
| Nith under voltage release | | | No |
| Number of poles | | | 4 |
| Position of connection for main current circuit | | | Front side |
| Type of control element | | | Rocker lever |
| Complete device with protection unit | | | Yes |
| Notor drive integrated | | | No |
| Motor drive optional | | | No |
| Degree of protection (IP) | | | IP20 |

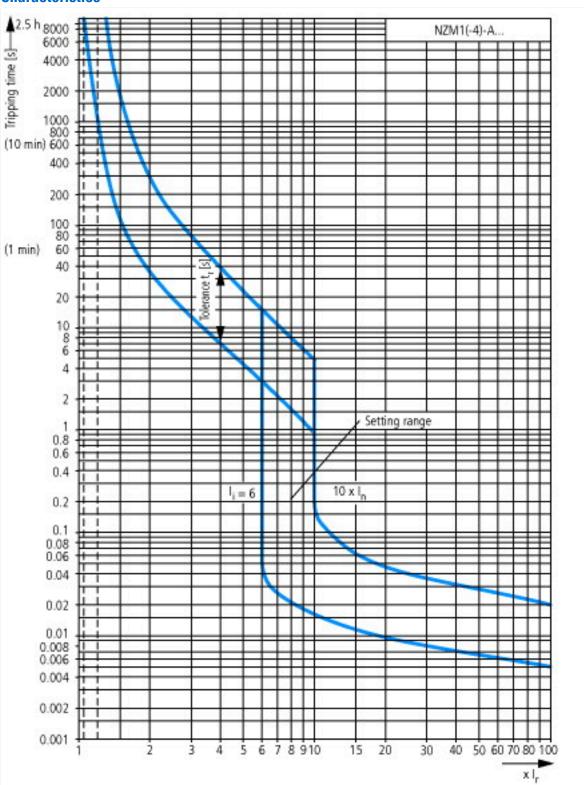


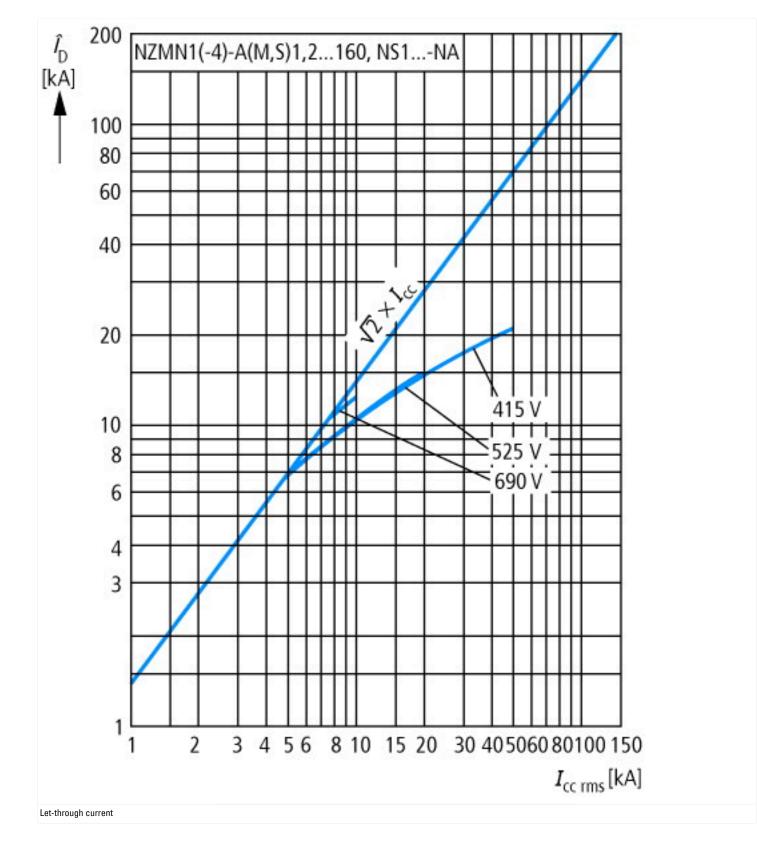

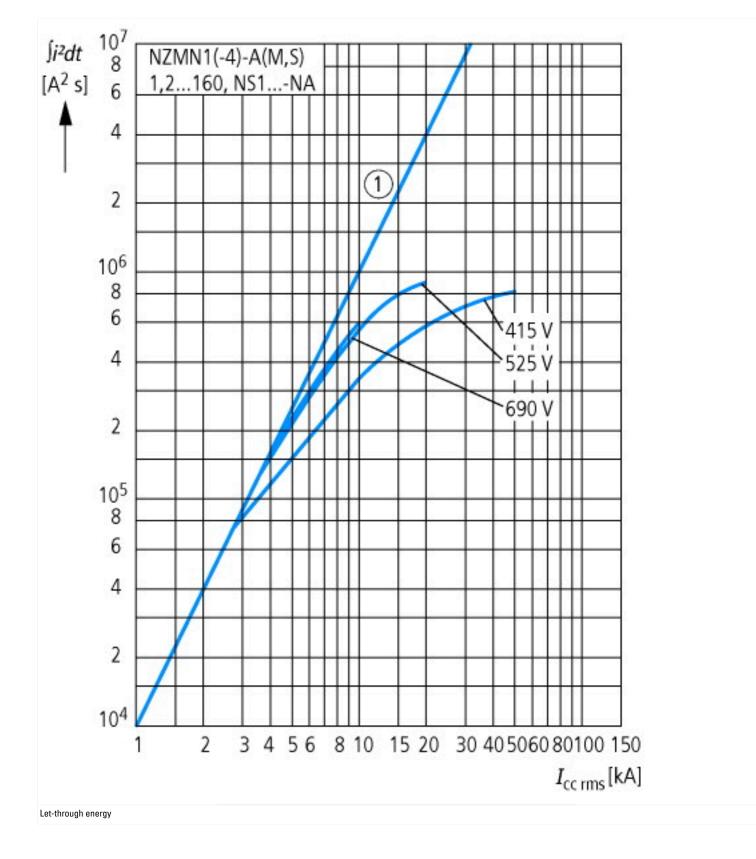



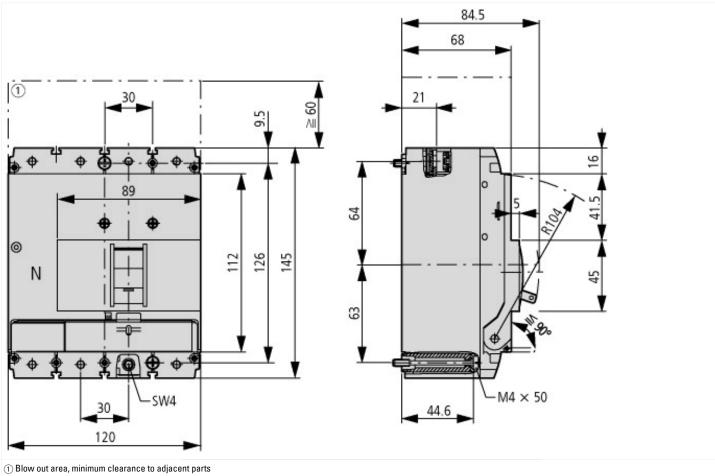

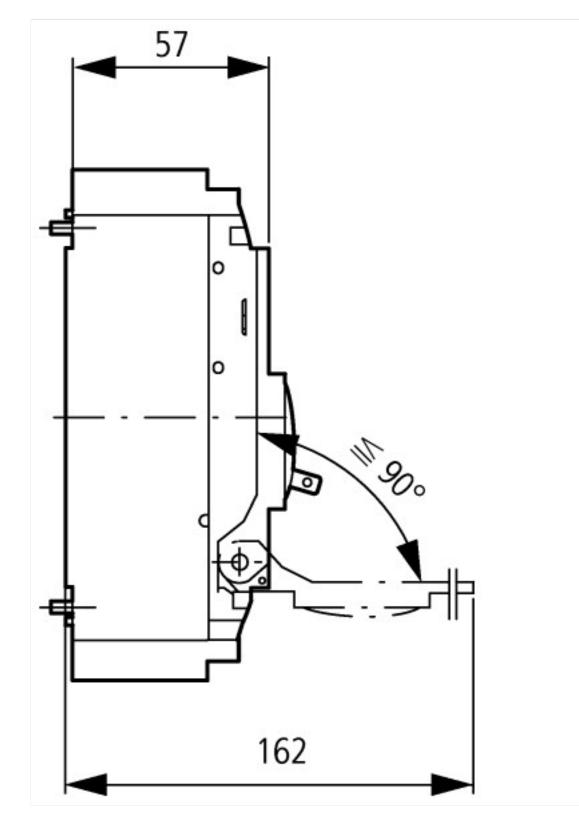

Additional product information (links)

| IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector | | | |
|--|--|--|--|
| IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector | https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf | | |
| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 | | |
| CurveSelect characteristics program | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm | | |
| additional technical information for NZM power switch | https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf | | |