DATASHEET - NZML4-4-AE1250



Circuit-breakers 4p 1250 A

Part no. NZML4-4-AE1250 Catalog No. 283227



Similar to illustration

Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
Installation type			Fixed
Release system			Electronic release
Construction size			NZM4
Description			Set value in neutral conductor is synchronous with set value Ir of main pole. R.m.s. value measurement and "thermal memory"
Number of poles			4 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	100
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	1250
Neutral conductor	% of phase conductor	%	100
Setting range			
Overload trip			
中	I _r	А	630 - 1250
Main pole	I _r	A	630 - 1250
Short-circuit releases			

Technical data

Non-delayed

General

delleral			
Standards			IEC/EN 60947
Protection against direct contact			Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
Ambient temperature, storage	0	C	- 40 - + 70
Operation	0	C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g]	15 (half-sinusoidal shock 11 ms)
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts	V	/ AC	500
between the auxiliary contacts	V	/ AC	300
Weight	k	cg	27

 $I_i = I_n \times \dots$

2 - 12

Mounting position			Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions	
Direction of incoming supply			as required	
Degree of protection				
Device			In the operating controls area: IP20 (basic degree of protection)	
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66	
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00	
Other technical data (sheet catalogue)			Temperature dependency, Derating	
Circuit-breakers				
Rated current = rated uninterrupted current	$I_n = I_u$	Α	1250	
Rated surge voltage invariability	U_{imp}			
Main contacts		V	8000	
Auxiliary contacts		V	6000	
Rated operational voltage	U _e	V AC	690	
Overvoltage category/pollution degree			III/3	
Rated insulation voltage	Ui	V	1000	
Use in unearthed supply systems		V	≦ 525	
Switching capacity				
Rated short-circuit making capacity	I _{cm}			
240 V	I _{cm}	kA	275	
400/415 V	I _{cm}	kA	220	
440 V 50/60 Hz	I _{cm}	kA	187	
525 V 50/60 Hz	I _{cm}	kA	143	
690 V 50/60 H	Ic	kA	105	
Rated short-circuit breaking capacity I _{cn}	I _{cn}			
Icu to IEC/EN 60947 test cycle O-t-CO	lcu	kA		
240 V 50/60 Hz	I _{cu}	kA	125	
400/415 V 50/60 Hz	I _{cu}	kA	100	
440 V 50/60 Hz	I _{cu}	kA	85	
525 V 50/60 Hz	I _{cu}	kA	65	
690 V 50/60 Hz	I _{cu}	kA	50	
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA		
240 V 50/60 Hz	I _{cs}	kA	63	
400/415 V 50/60 Hz	I _{cs}	kA	50	
440 V 50/60 Hz	I _{cs}	kA	43	
525 V 50/60 Hz		kA	49	
690 V 50/60 Hz	I _{cs}	kA	37	
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.	n
Rated short-time withstand current			• • • • • • • • • • • • • • • • • • • •	
t = 0.3 s	I _{cw}	kA	19.2	
t = 1 s	I _{cw}	kA	19.2	
Utilization category to IEC/EN 60947-2	·CVV		A	
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		10000	
Lifespan, electrical	oporations.			
AC-1				

400 V 50/60 Hz	Operations		3000
415 V 50/60 Hz	Operations		3000
690 V 50/60 Hz	Operations		2000
AC3	Operations		2000
400 V 50/60 Hz	Operations		2000
	Operations		
415 V 50/60 Hz	Operations		2000
690 V 50/60 Hz	Operations		1000
Max. operating frequency		Ops/h	60
Total break time at short-circuit		ms	< 25 ≤ 415 V; < 35 > 415 V
Terminal capacity			Screw connection
Standard equipment			
Optional accessories			Tunnel terminal connection on rear Strip terminal
Round copper conductor			
Tunnel terminal			
Stranded			
4-hole		mm ²	4 x (50 - 240)
Bolt terminal and rear-side connection			
Direct on the switch			
Stranded		2	1 x (120 - 185)
Granded		mm ²	4 x (50 - 185)
Module plate			
Single hole	min.	mm ²	1 x (120 - 300)
Single hole	max.	mm ²	2 x (95 - 300)
		mm	2.1(60 000)
Module plate			0. (05. 405)
Double hole	min.	mm ²	2 x (95 - 185)
Double hole	max.	mm^2	4 x (35 - 185)
Connection width extension		mm ²	
Connection width extension		mm ²	4 x 300
Comocion Wall Oxfords		mm	6 x (95 - 240)
Al circular conductor			
Tunnel terminal			
Stranded			
4-hole		mm ²	4 x (50 - 240)
Cu strip (number of segments x width x segment thickness)			
Flat conductor terminal			
	min.	mm	6 x 16 x 0.8
	max.	mm	(2 x) 10 x 32 x 1.0
Module plate	illa.	11411	[EN] 10 A OE A 1.0
Single hole		mm	(2 x) 10 x 50 x 1.0
Bolt terminal and rear-side connection		11/111	12.0/ 10.0.00 \$ 1.0
	t		E v 25 v 10
Flat copper strip, with holes	min.	mm	5 x 25 x 1.0
Flat copper strip, with holes	max.	mm	(2 x) 10 x 50 x 1.0
Connection width extension		mm	(2 x) 10 x 80 x 1.0
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M10
Direct on the switch	min.	mm	25 x 5
	max.	mm	2 x (50 x 10)
Module plate			
Single hole	min.	mm	25 x 5
Single hole	max.	mm	2 x (50 x 10)
Module plate			
Double hole		mm	2 x (50 x 10)

Connection width extension		mm	
Connection width extension	min.	mm	60 x 10
Connection width extension	max.	mm	2 x (80 x 10)
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	1250
Equipment heat dissipation, current-dependent	P _{vid}	W	173.44
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
$10.2.3.3\ Verification\ of\ resistance\ of\ insulating\ materials\ to\ abnormal\ heat\ and\ fire\ due\ to\ internal\ electric\ effects$			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

protection (cci @3310.0.1 27 07 04 00 [A02710010])		
Rated permanent current lu	А	1250
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	100
Overload release current setting	А	630 - 1250
Adjustment range short-term delayed short-circuit release	А	0 - 0
Adjustment range undelayed short-circuit release	А	2500 - 15000
Integrated earth fault protection		No
Type of electrical connection of main circuit		Screw connection
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		No

Number of auxiliary contacts as normally closed contact	0
Number of auxiliary contacts as normally open contact	0
Number of auxiliary contacts as change-over contact	0
With switched-off indicator	No
With under voltage release	No
Number of poles	4
Position of connection for main current circuit	Front side
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20

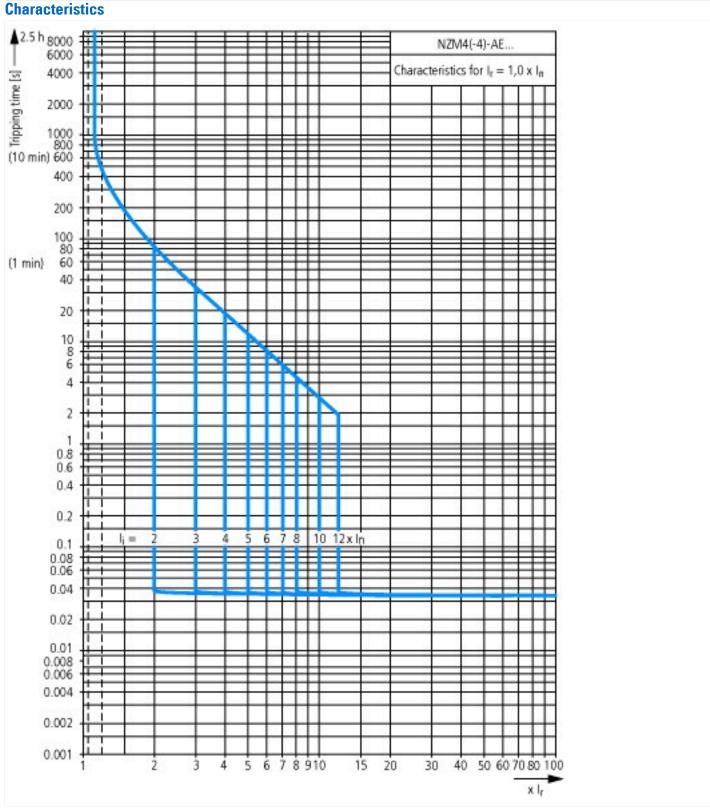

Dimensions

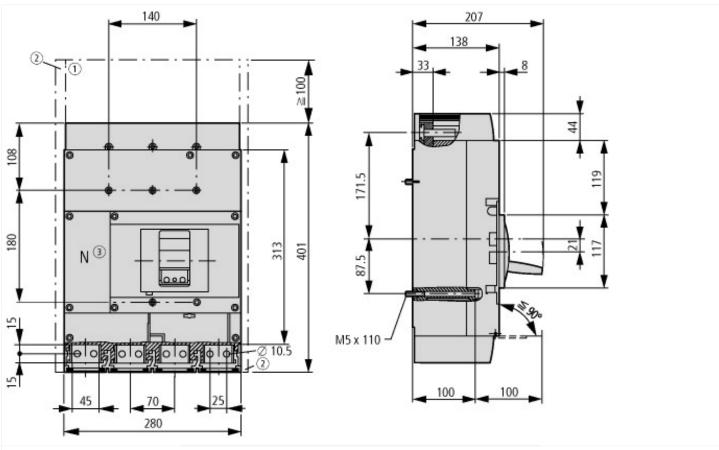

- ① Blow out area, minimum clearance to adjacent parts Ui \leq 690 V: 100 mm Ui \leq 1500 V: 200 mm ② Minimum clearance to adjacent parts Ui \leq 1000 V: 15 mm Ui \leq 1500 V: 70 mm

Additional product information (links)

•		
IL01210010Z (AWA1230-2022) Circuit-Breaker, basic unit		
IL01210010Z (AWA1230-2022) Circuit-Breaker, basic unit	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL01210010Z2018_11.pdf	
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172	
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm	
Eaton configurator	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/ConfiguratorCircuitBreaker/index.htm	
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf	